




**OUTLET DETAIL
INTO TABLE DRAIN**

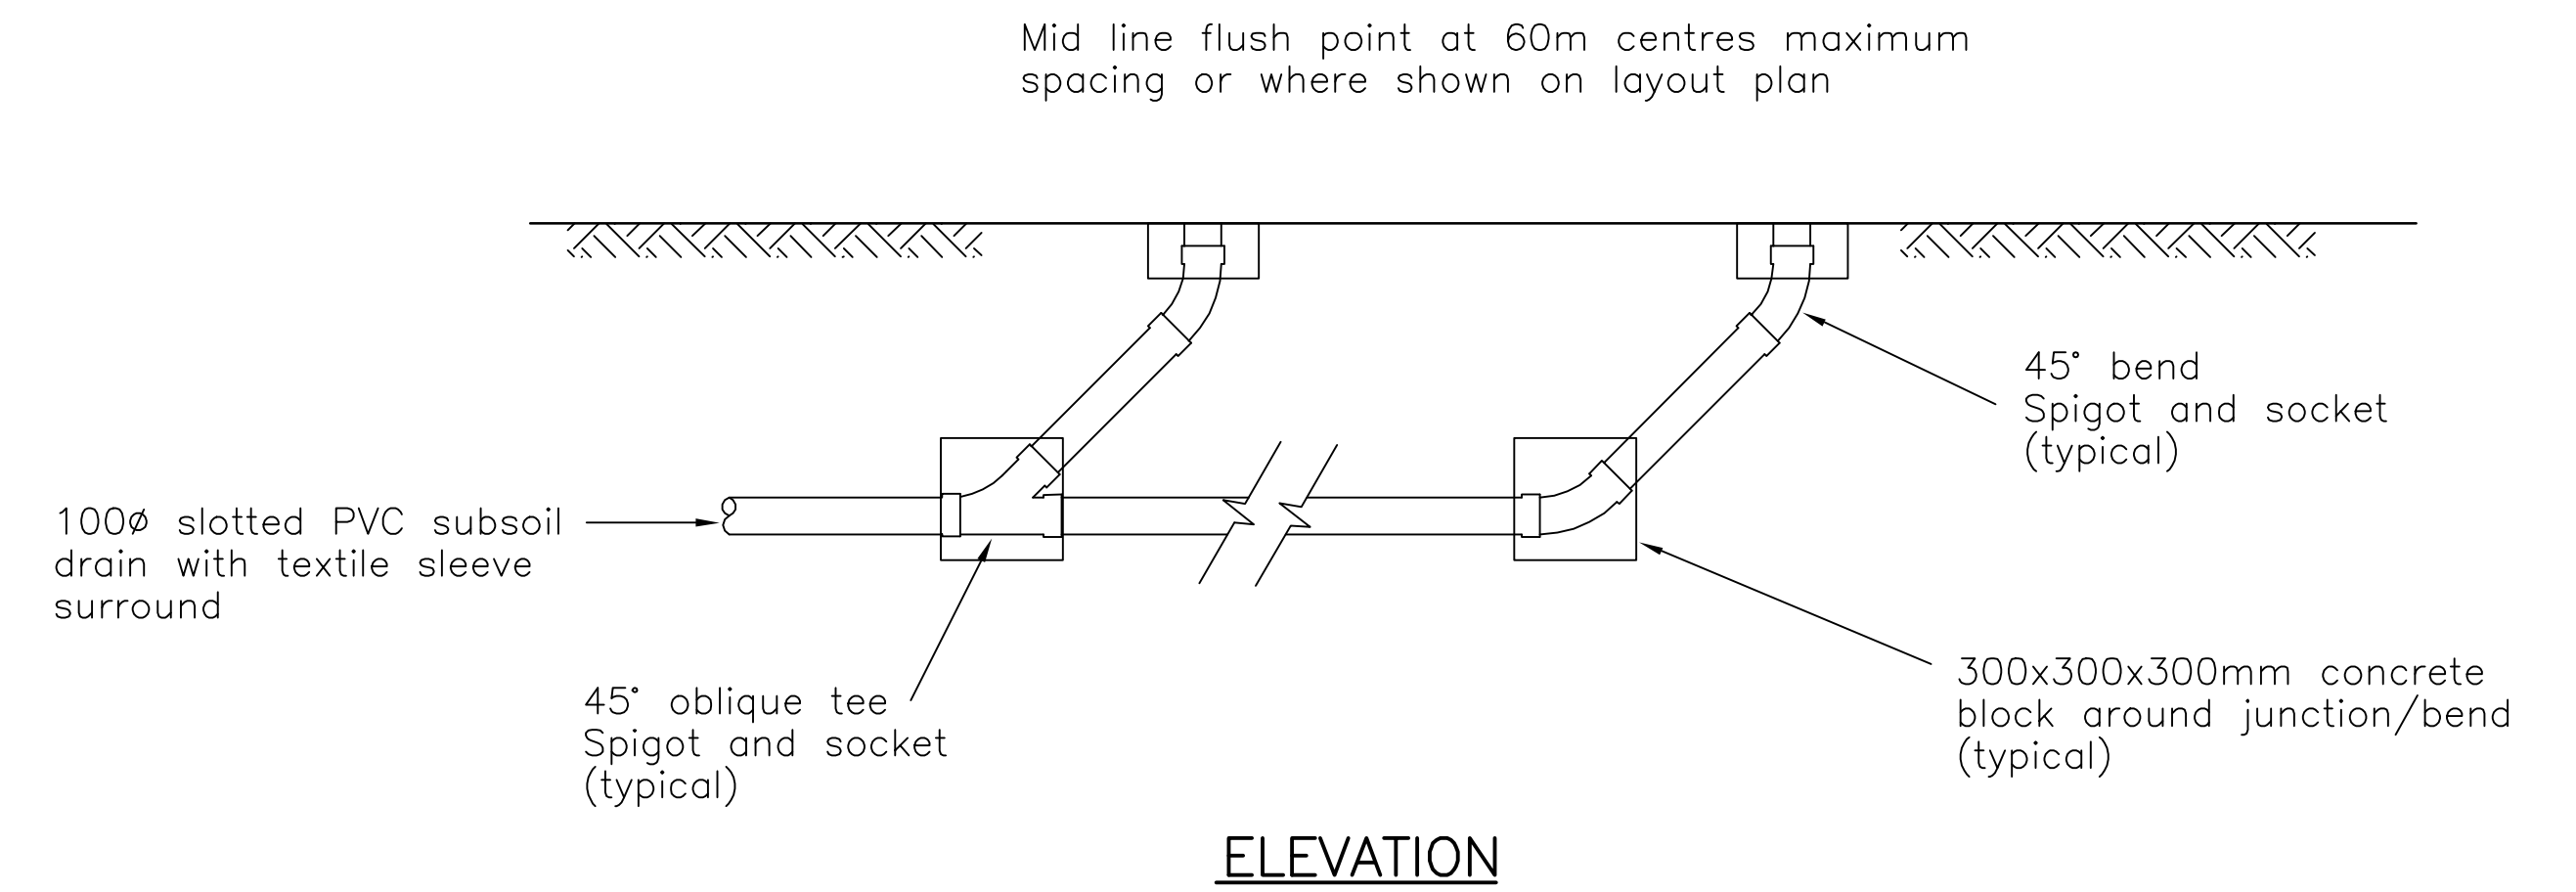


ELEVATION

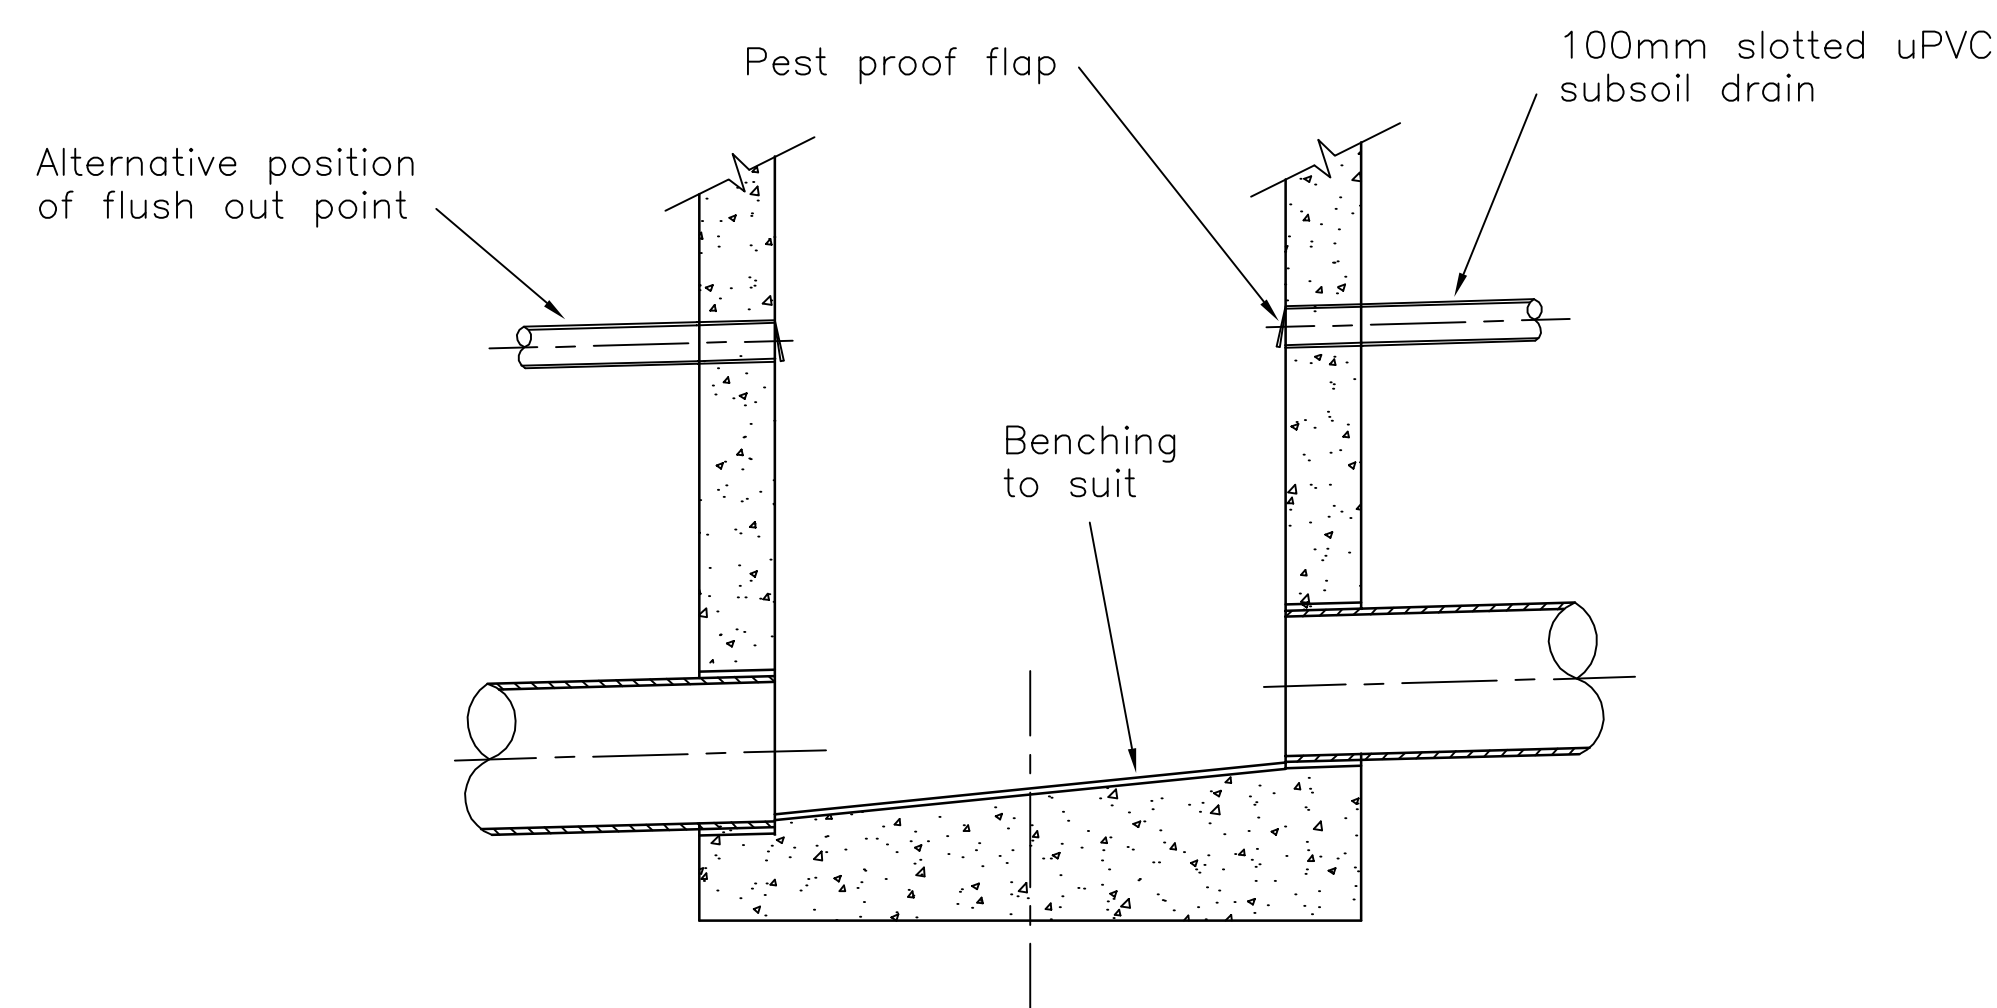

**SUBSOIL DRAIN DETAIL
AT MANHOLE AND GULLY PITS**

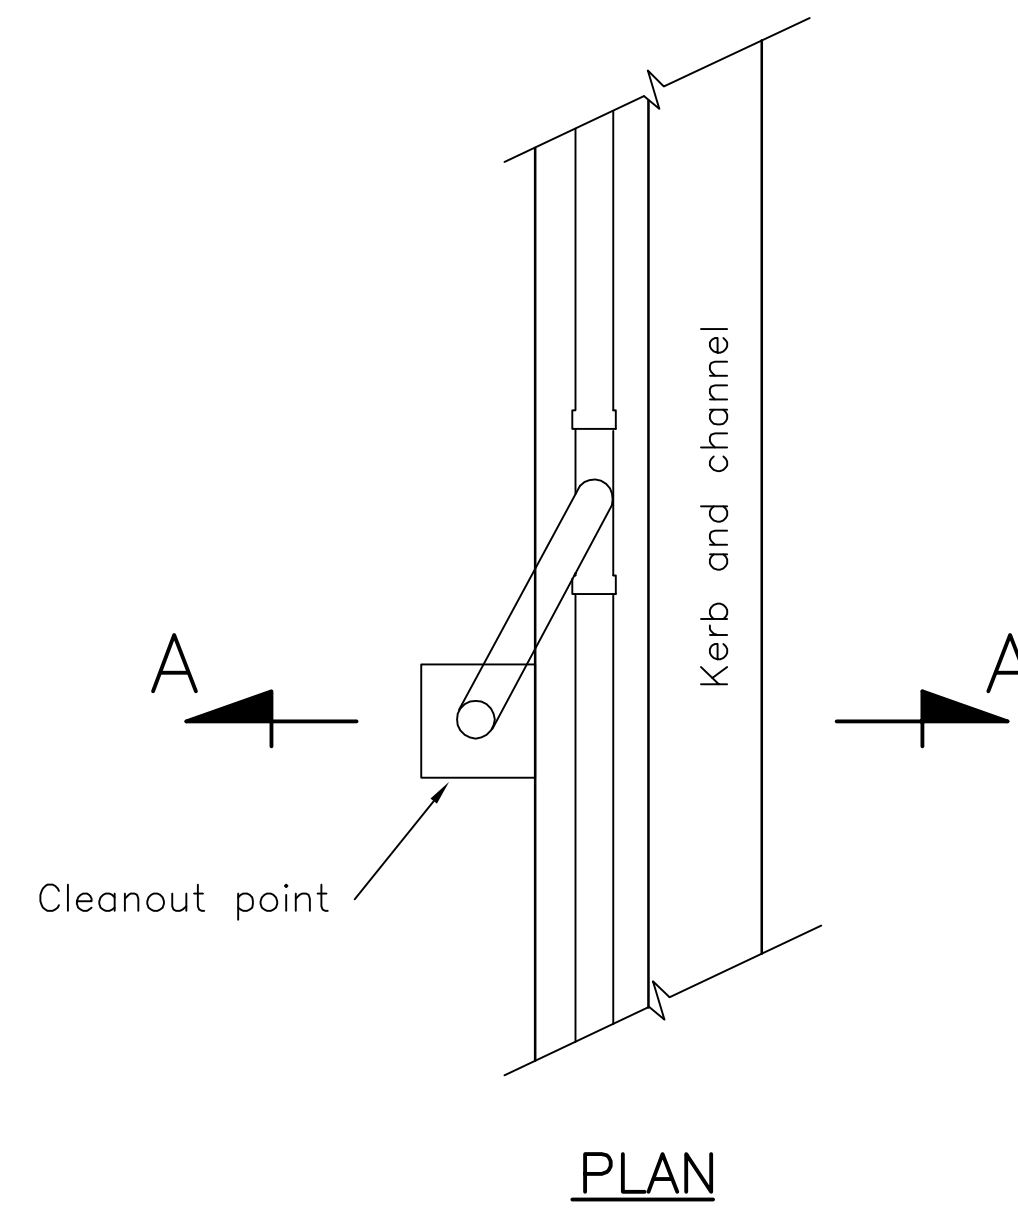

PLAN

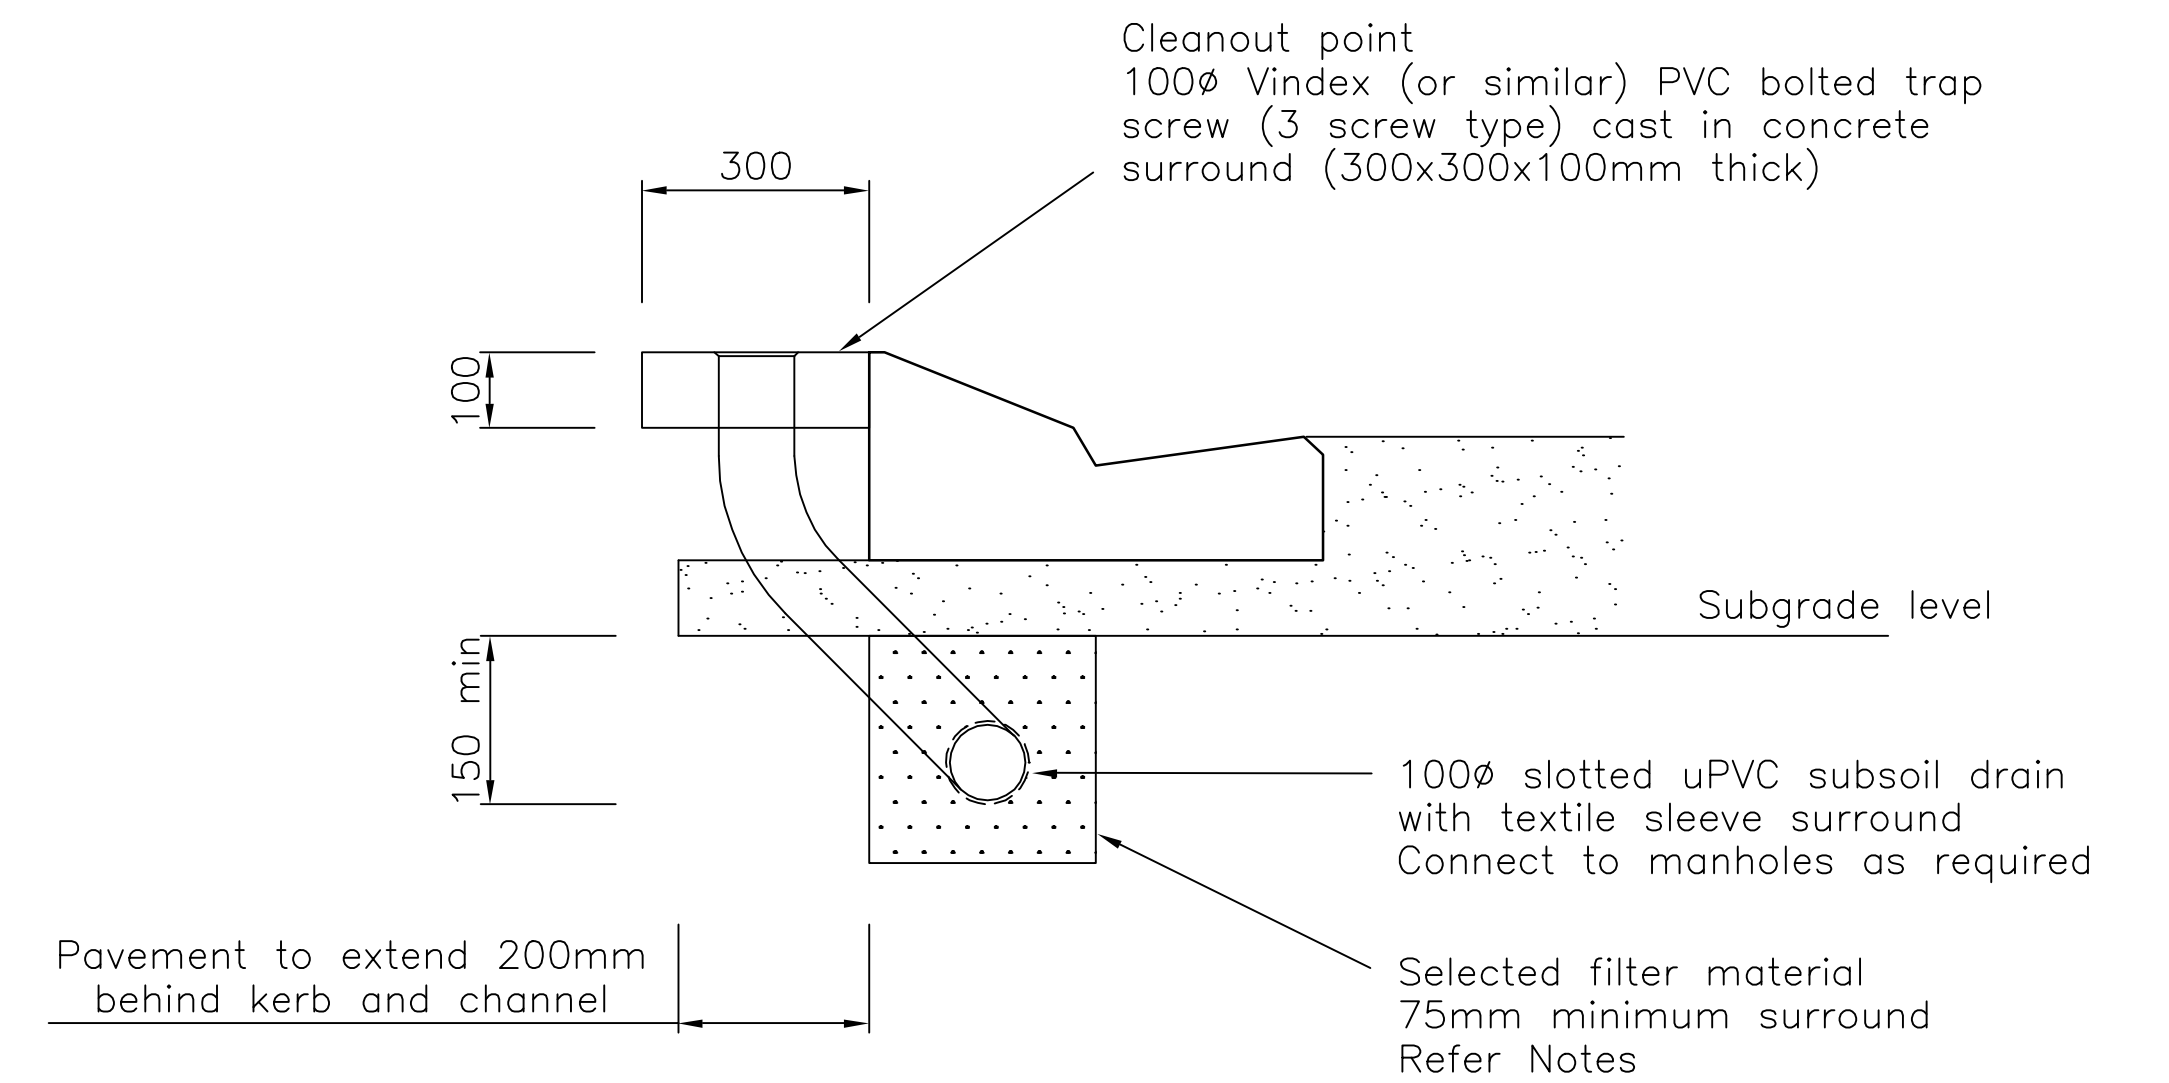

SECTION A-A

NOTES

1. All dimensions are in millimetres unless noted otherwise.
2. Subsoil drains to be graded at 0.5% minimum to outlet.
3. Where the subsoil drain discharges into a stormwater manhole, the outlet of the subsoil drain shall be located above the top of the stormwater pipes.
4. The subsoil drain outlets shall be provided with pest proof flaps.
5. Provide subsoil drain cleanout points at the head of subsoil drain and at 60m maximum spacings for pipe type drains and 50m for strip filter type drains.
6. Selected filter material shall be 10mm screenings unless noted otherwise.

A		29/3/2000	ORIGINAL ISSUE	
No.	DATE	DESCRIPTION		AP'D
REVISIONS				

NOTES : Not to Scale



CITY OF THURINGOWA

86 Thuringowa Drive, Thuringowa Central, QLD. 4817

Phone: 07 4773 8411 Fax: 07 4773 8600

DRAWN: NRN

Engineer Approved: Original Signed by B.Sue Date: 4/2000

CHECKED: WJP

D.E.S. Approved: Original Signed by B.Bailey Date: 5/2000

SUBSOIL DRAIN

**STANDARD
DRAWING
ROADWORKS**

10090

A