



NOTES

- All dimensions are in millimetres unless noted otherwise.
- Long service – Water main on opposite side of street to allotment.
Short service – Water main on same side of street as allotment.
- Cover for service pipes:
Under roadway: 600mm min – 1000mm max.
Under footpath: 450mm min – 750mm max.
- Services to be located on offset of 1200mm from side property boundary where feasible. Service may be located to suit owner. Installation may be set parallel to or perpendicular to front boundary to suit consumer's requirements.
- Diameter of flow meter and pipework to suit required capacity of the installation.
- Service pipe to be RRJ uPVC Class 15 to AS 1477 Series 1 for 80mm diameter and RRJ uPVC Class 16 to AS 1477 Series 2 (OD compatible) for 100mm diameter and larger.
- DI fittings to be fusion bonded nylon or epoxy coated internally and externally. DI pipe to be epoxy coated externally.
- Pipe to be installed by boring under existing roads. Refer Drawing 10305.
- Where more than one meter services the property a single check valve will be installed after the meter.
- Detector check valve to be a Davey Shepard check or equivalent. Details of proposed detector check to be provided.
- Materials to comply with AS 3500.

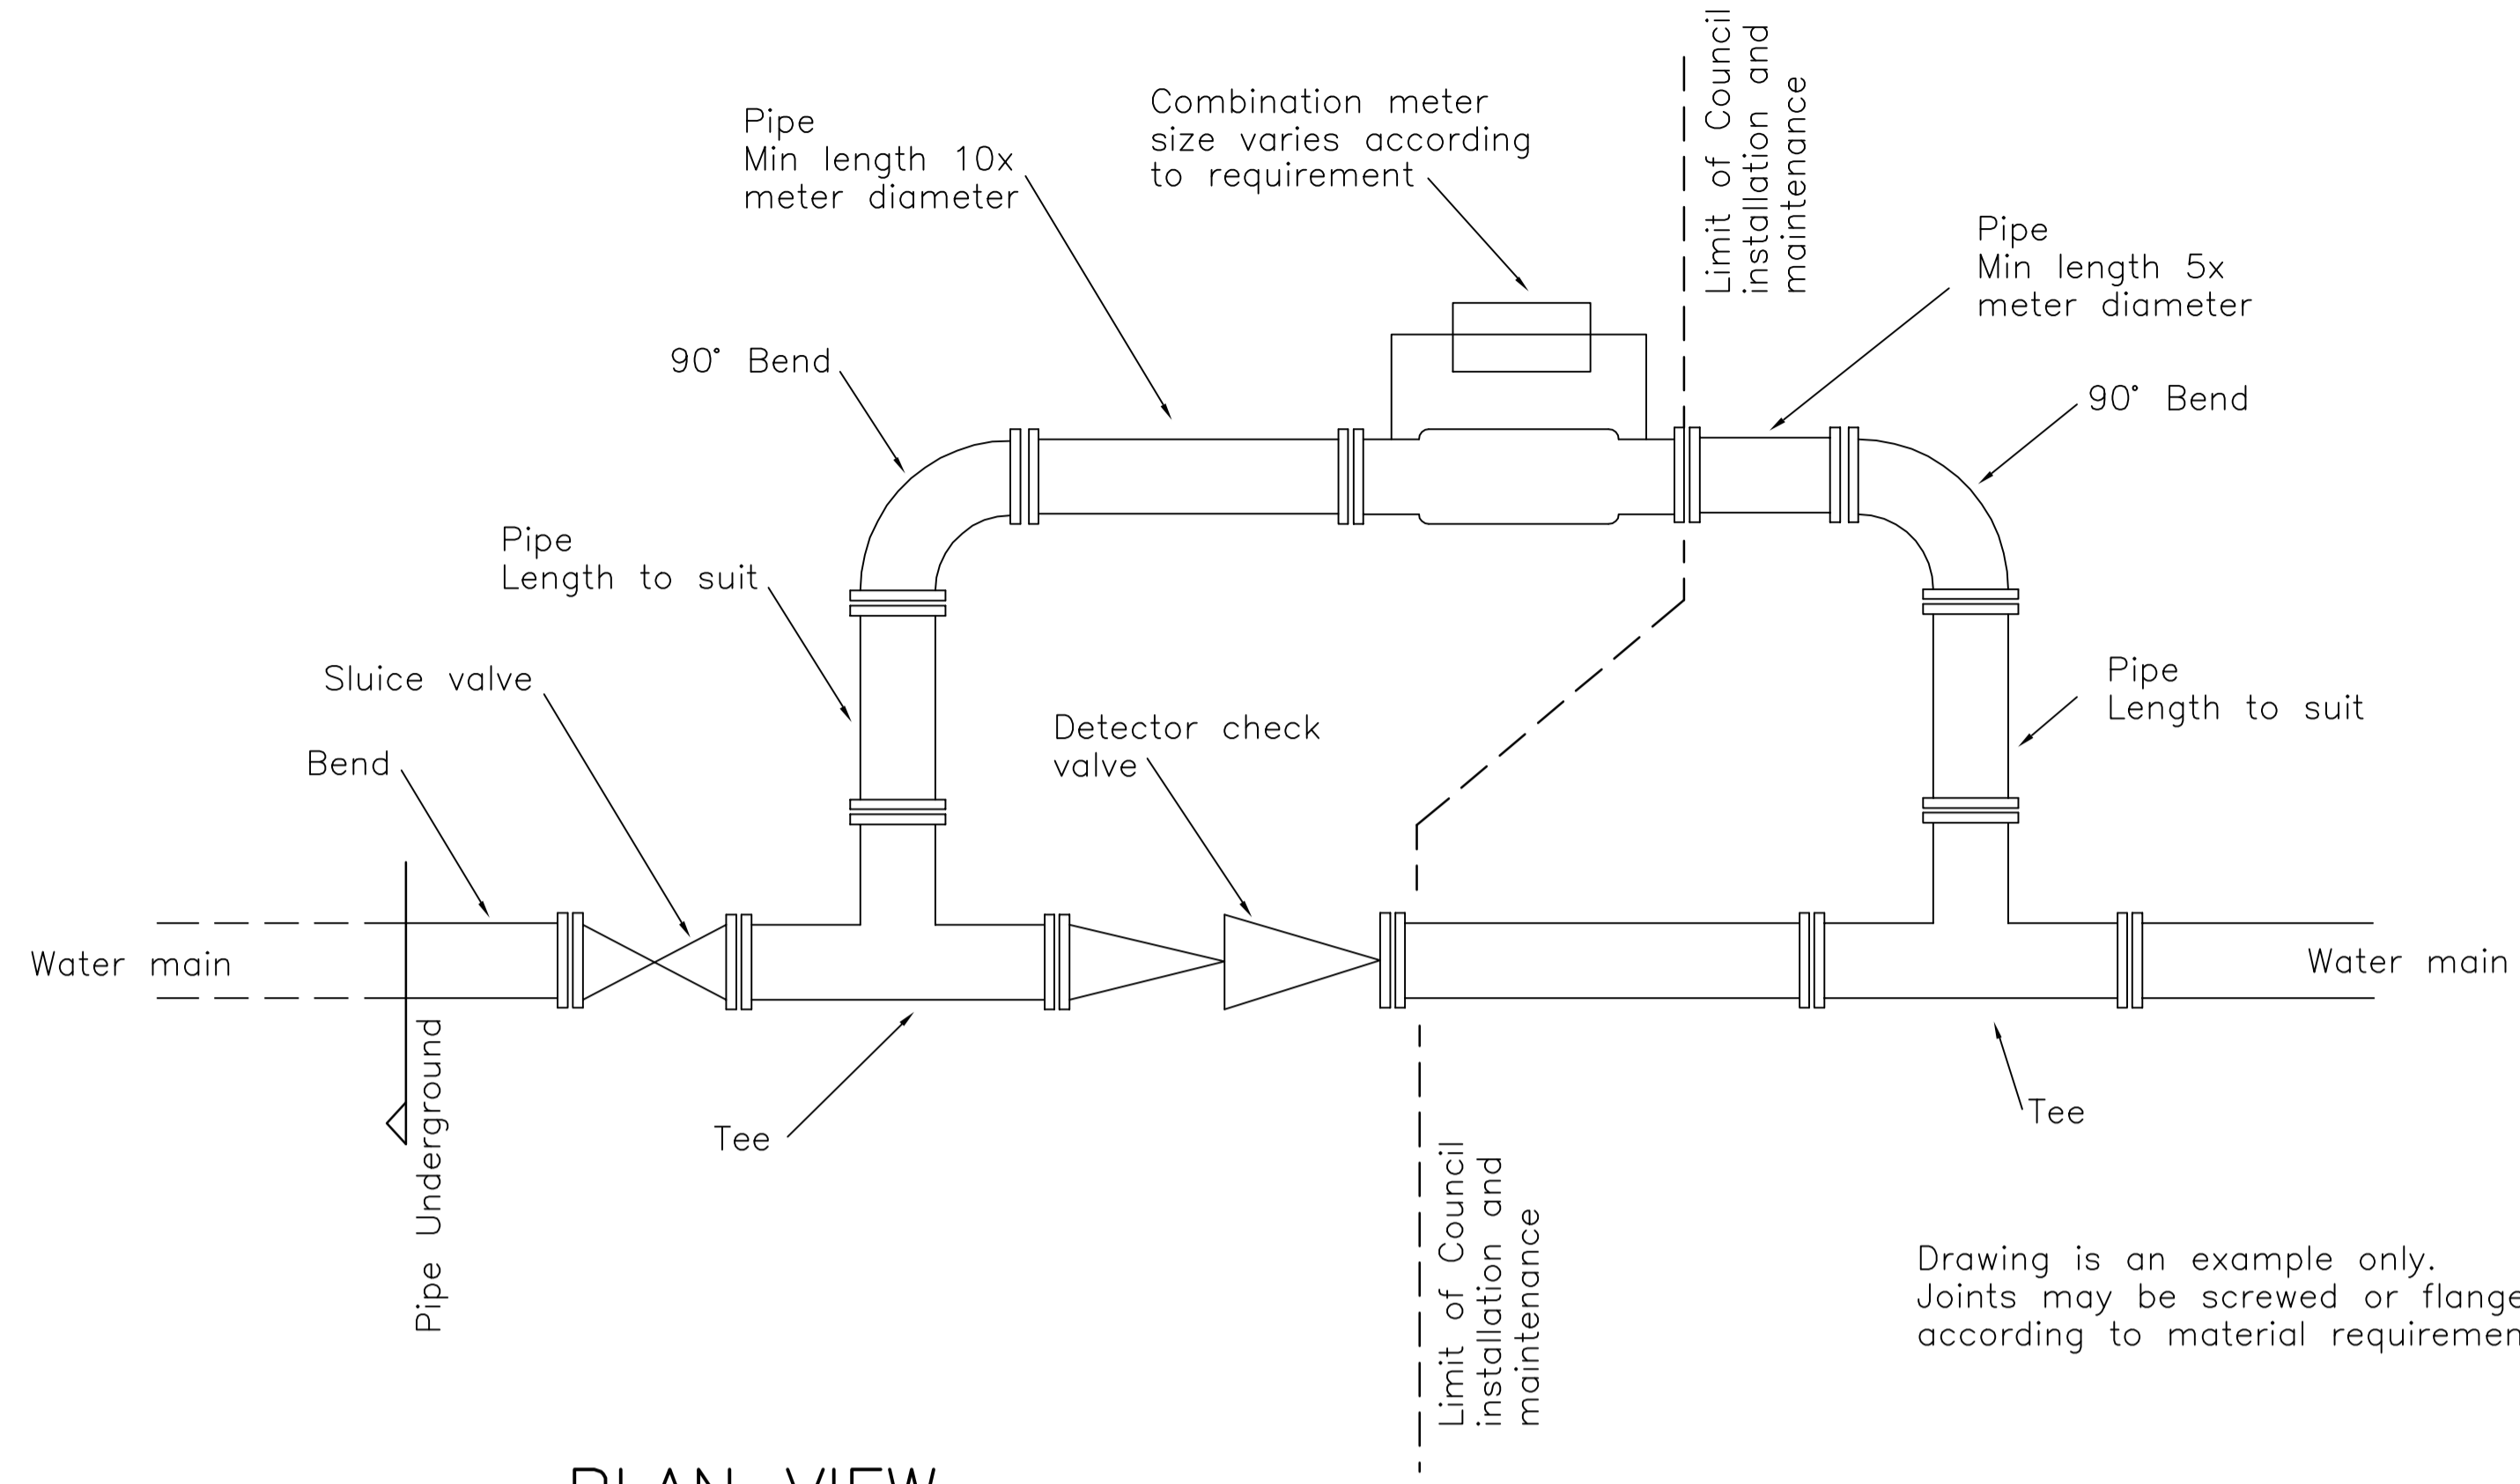

PLAN VIEW

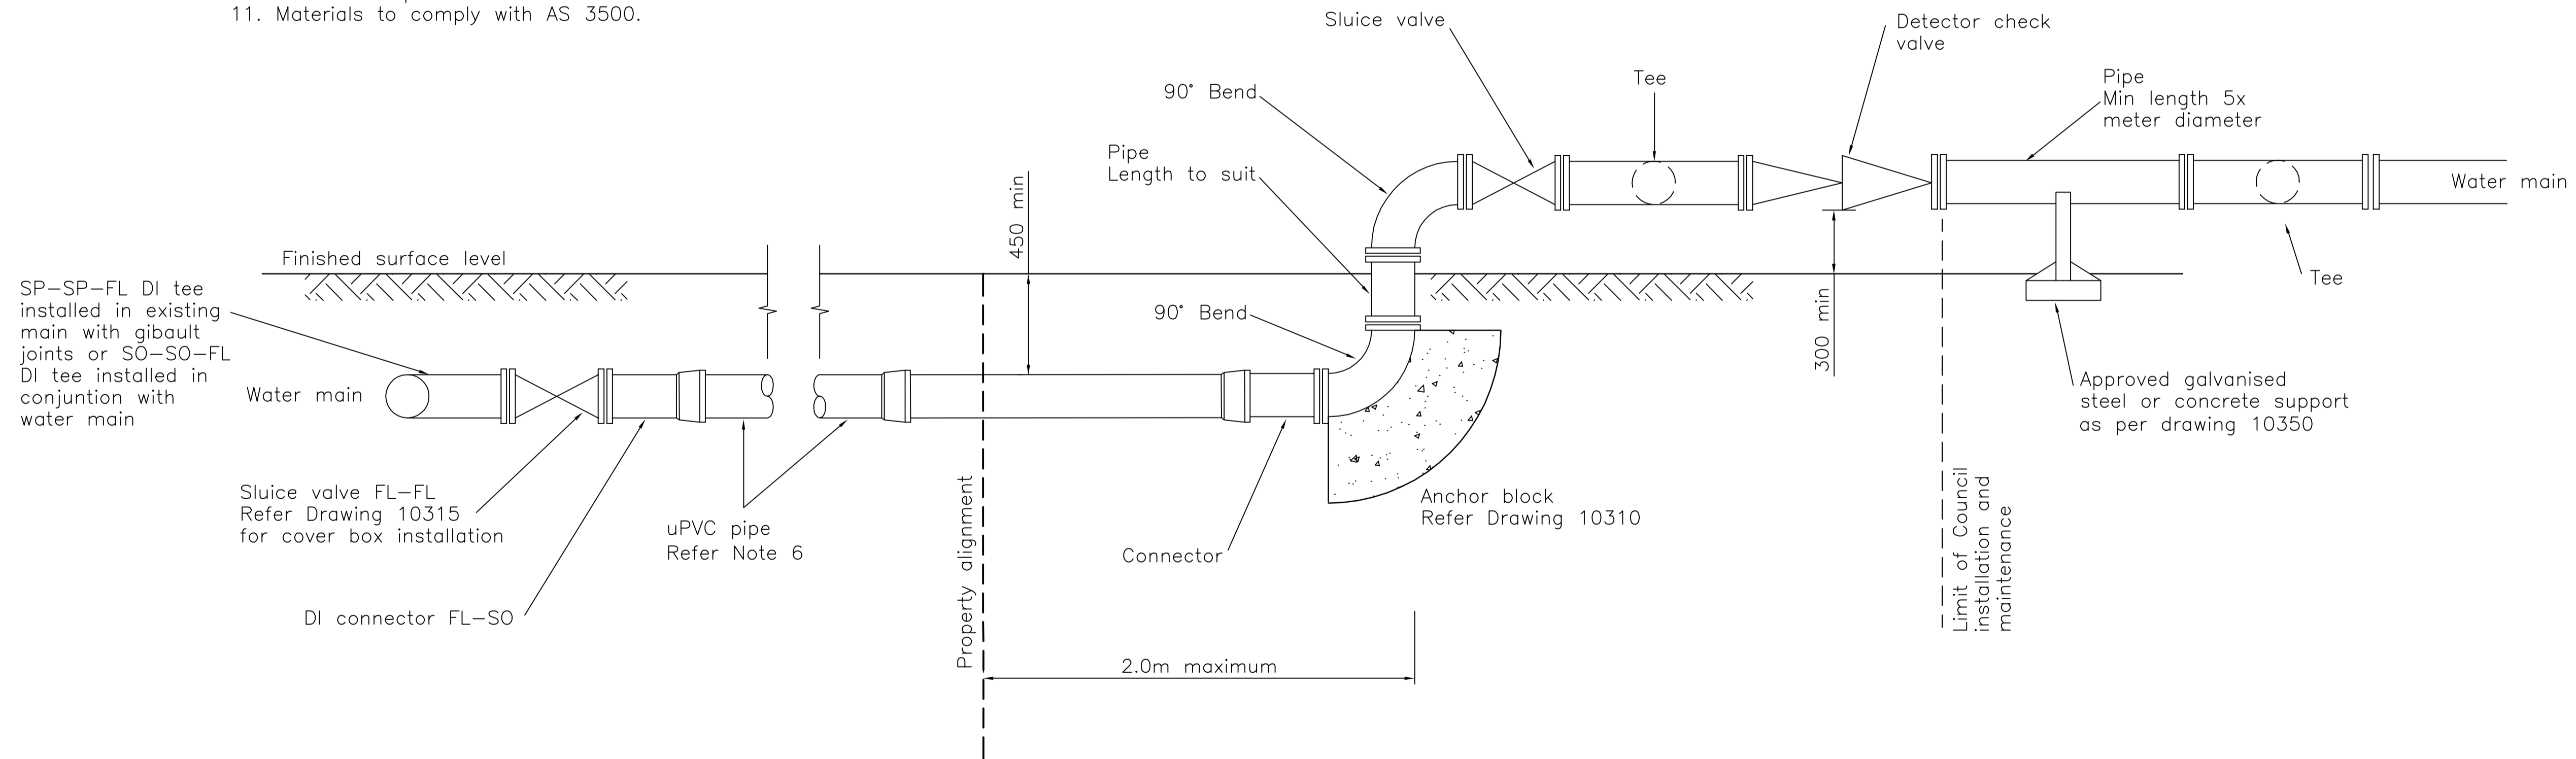

TYPICAL ELEVATION

NOTES :
Not to Scale



CITY OF THURINGOWA

86 Thuringowa Drive, Thuringowa Central, QLD. 4817
Phone: 07 4773 8411 Fax: 07 4773 8600

DRAWN: CAP

Engineer Approved: Original Signed by C.Phillips Date: 1/10/2001

CHECKED: T.Healey

D.E.S. Approved: Original Signed by B.Bailey Date: 1/10/2001

**COMMERCIAL WATER METER OPTION
DETECTOR CHECK
ALTERNATIVE TO
FIRE FLOW METERING**

**STANDARD
DRAWING
WATER**

10346

No.	DATE	DESCRIPTION	AP'D
A	3/9/2001	ORIGINAL ISSUE	
REVISIONS			

A