


TYPICAL ELEVATION (WATER MAIN ON OPPOSITE SIDE OF ROAD)

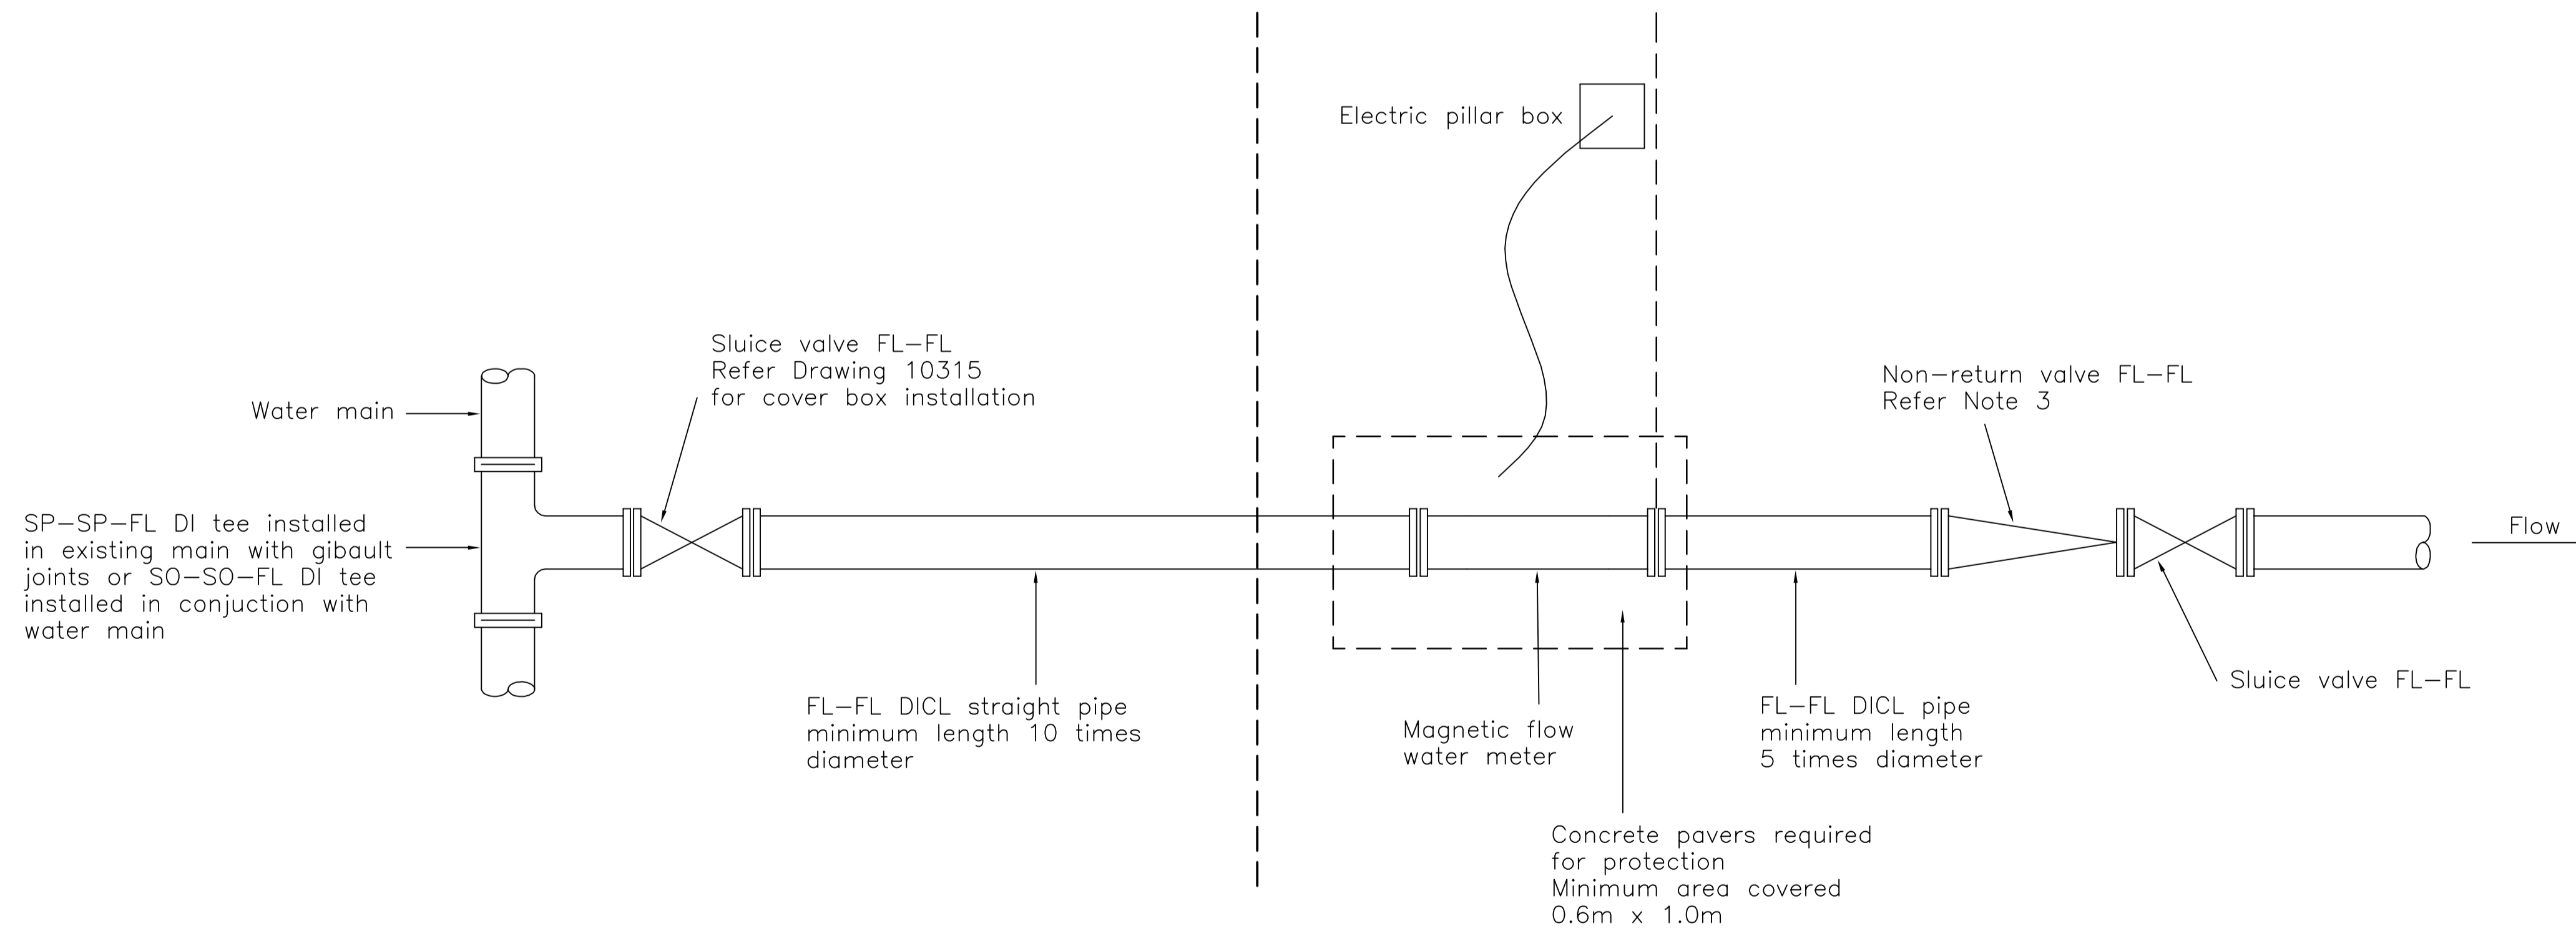

TYPICAL PLAN (WATER MAIN ON SAME SIDE OF ROAD)

NOTES

1. Diameter of flow meter and pipework to suit required capacity of the installation.
2. Flow meter installation may be set parallel to or perpendicular to front boundary to suit consumer's requirements.
3. Non-return valve to be in approved pit with safety lid if installed underground.
4. Pipe to be installed by boring under existing roads. Refer Drawing 10305.
5. The flow cut off calibration setting for the Magnetic Flow Meters to be confirmed by Council prior to installation.

NOTES : Not to Scale
Supersedes 10048A



CITY OF THURINGOWA

86 Thuringowa Drive, Thuringowa Central, QLD. 4817

Phone: 07 4773 8411 Fax: 07 4773 8600

DRAWN: NRN

Engineer Approved: Original Signed by C. Phillips Date: 30/5/2000

CHECKED: WJP

D.E.S. Approved: Original Signed by B. Bailey Date: 30/5/2000

MAGNETIC FLOW METER
INSTALLATION

STANDARD
DRAWING
WATER

10355

B	29/5/2000	CALIBRATION NOTE ADDED	
A	1/7/99	ORIGINAL ISSUE	
No.	DATE	DESCRIPTION	AP'D
REVISIONS			

A	B				
---	---	--	--	--	--