




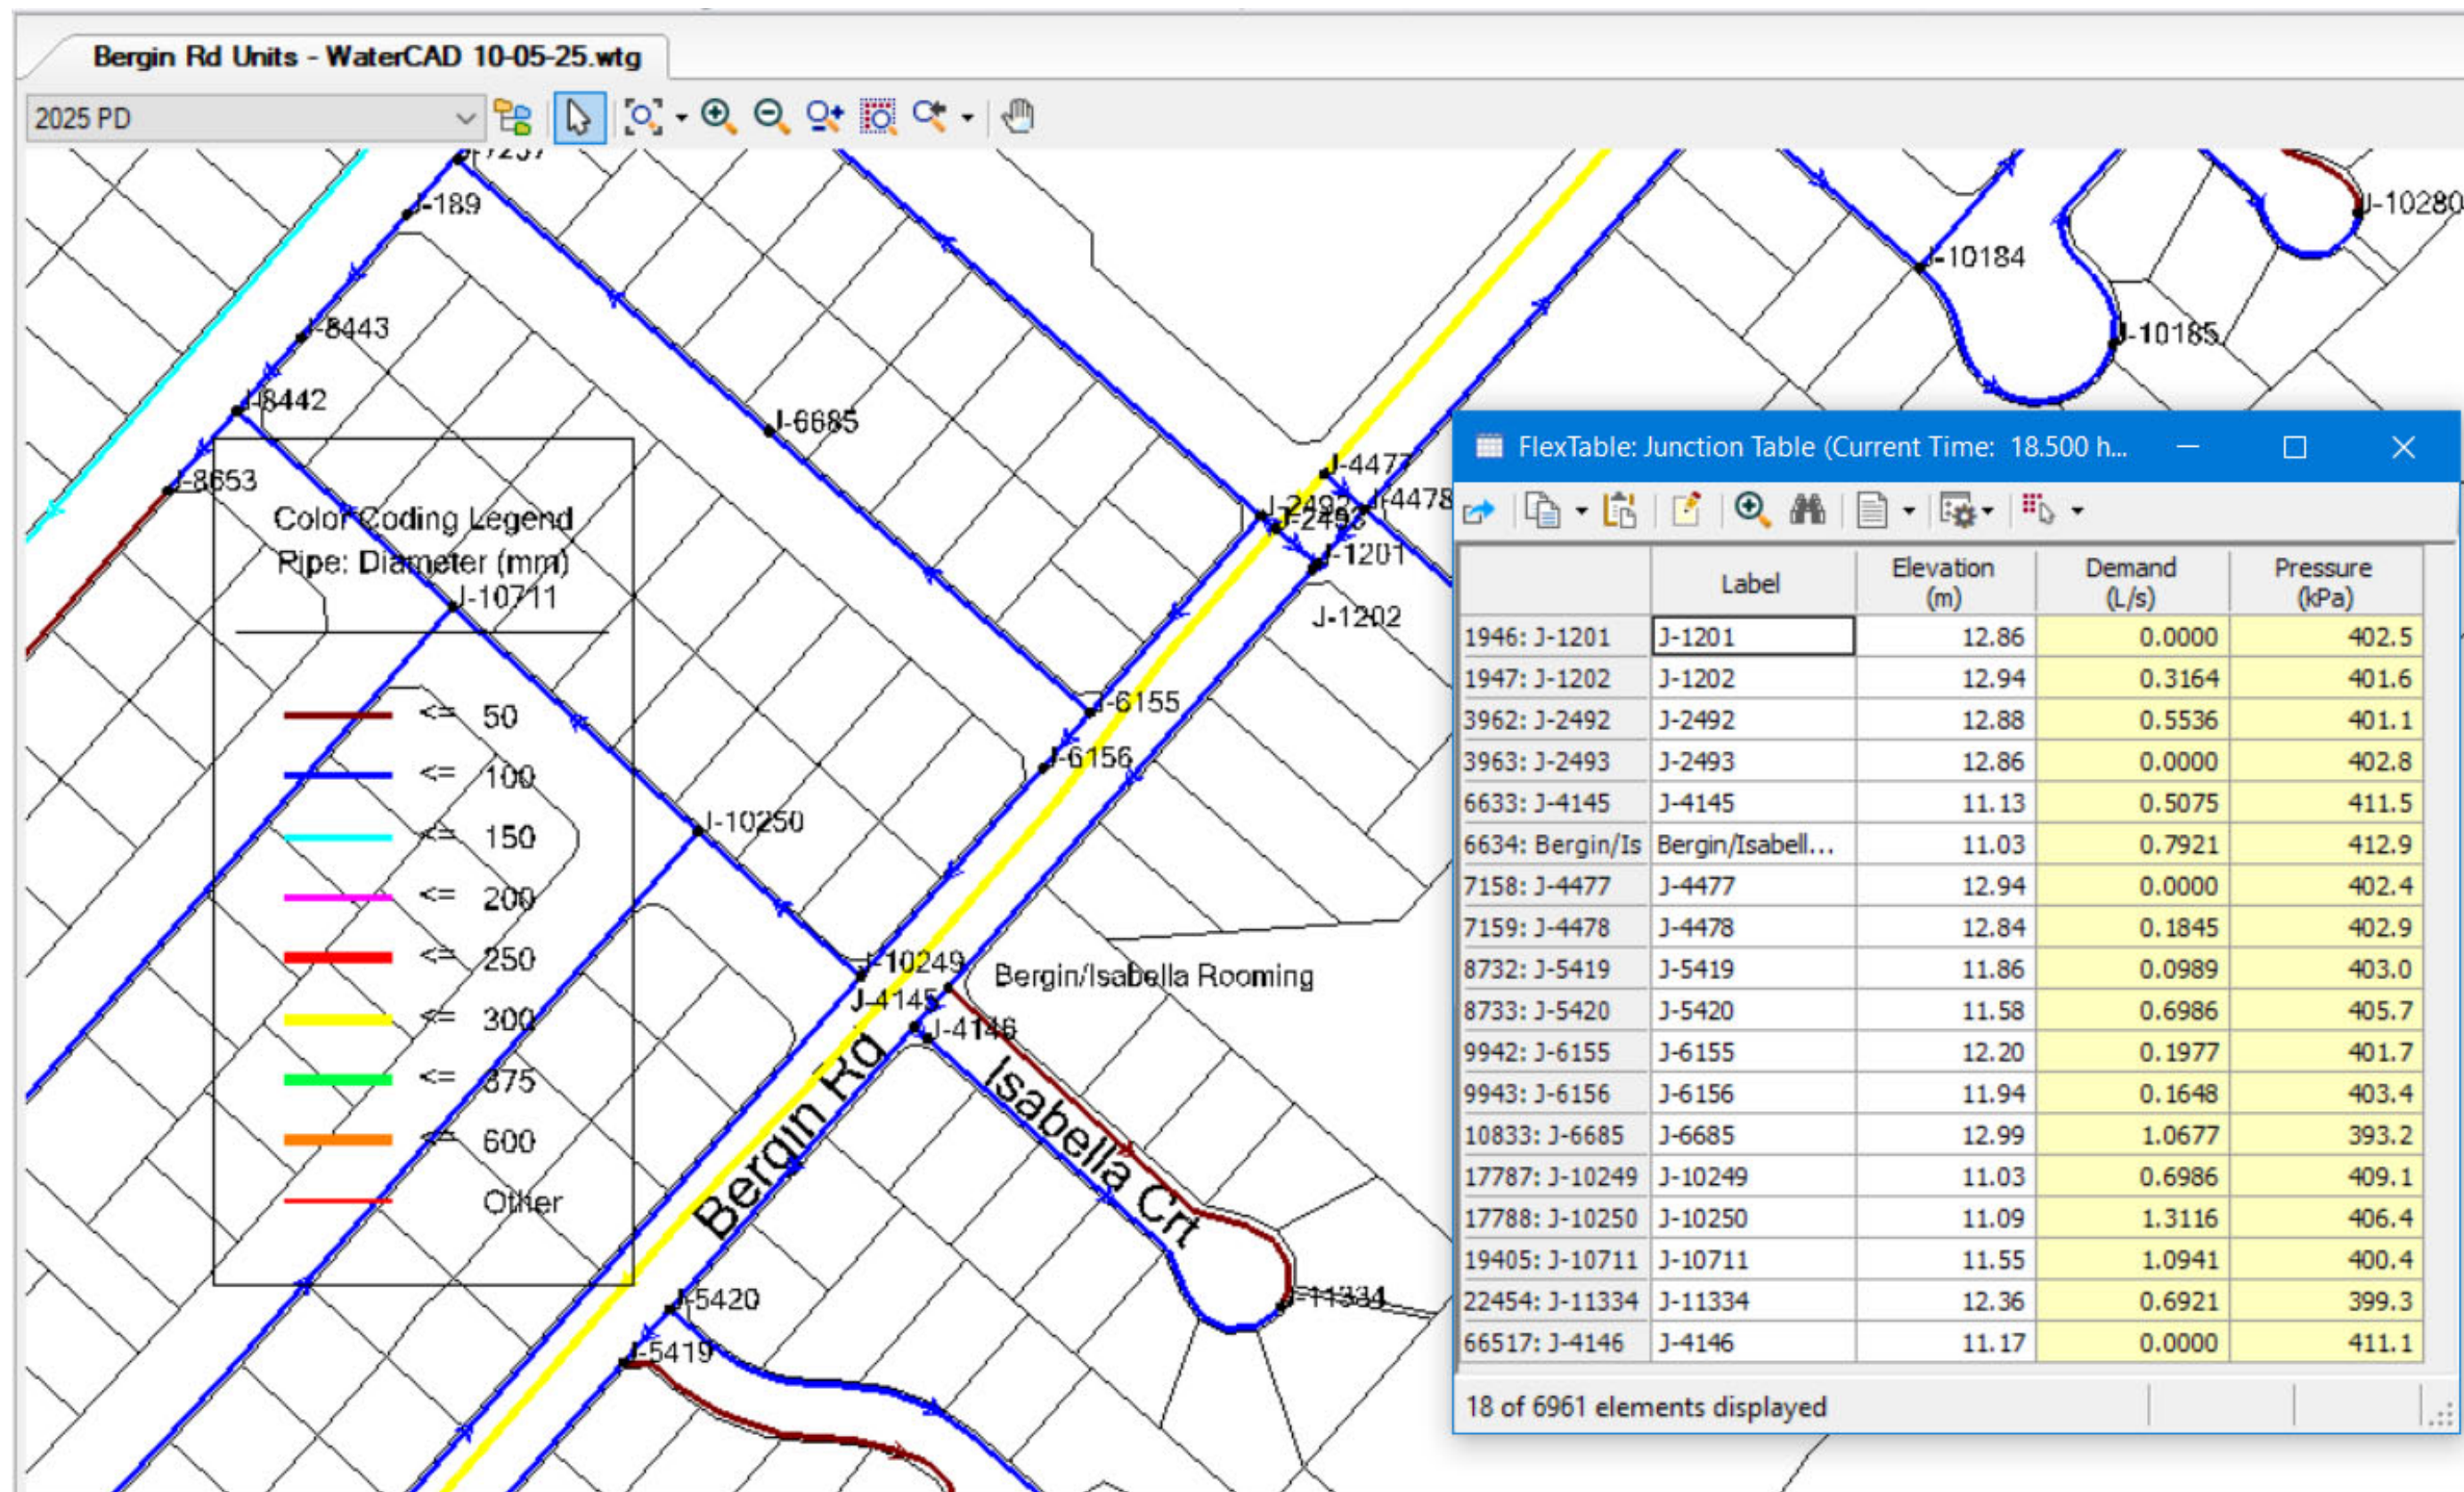


Peak Hour Node Modelling Results – 6:30 pm

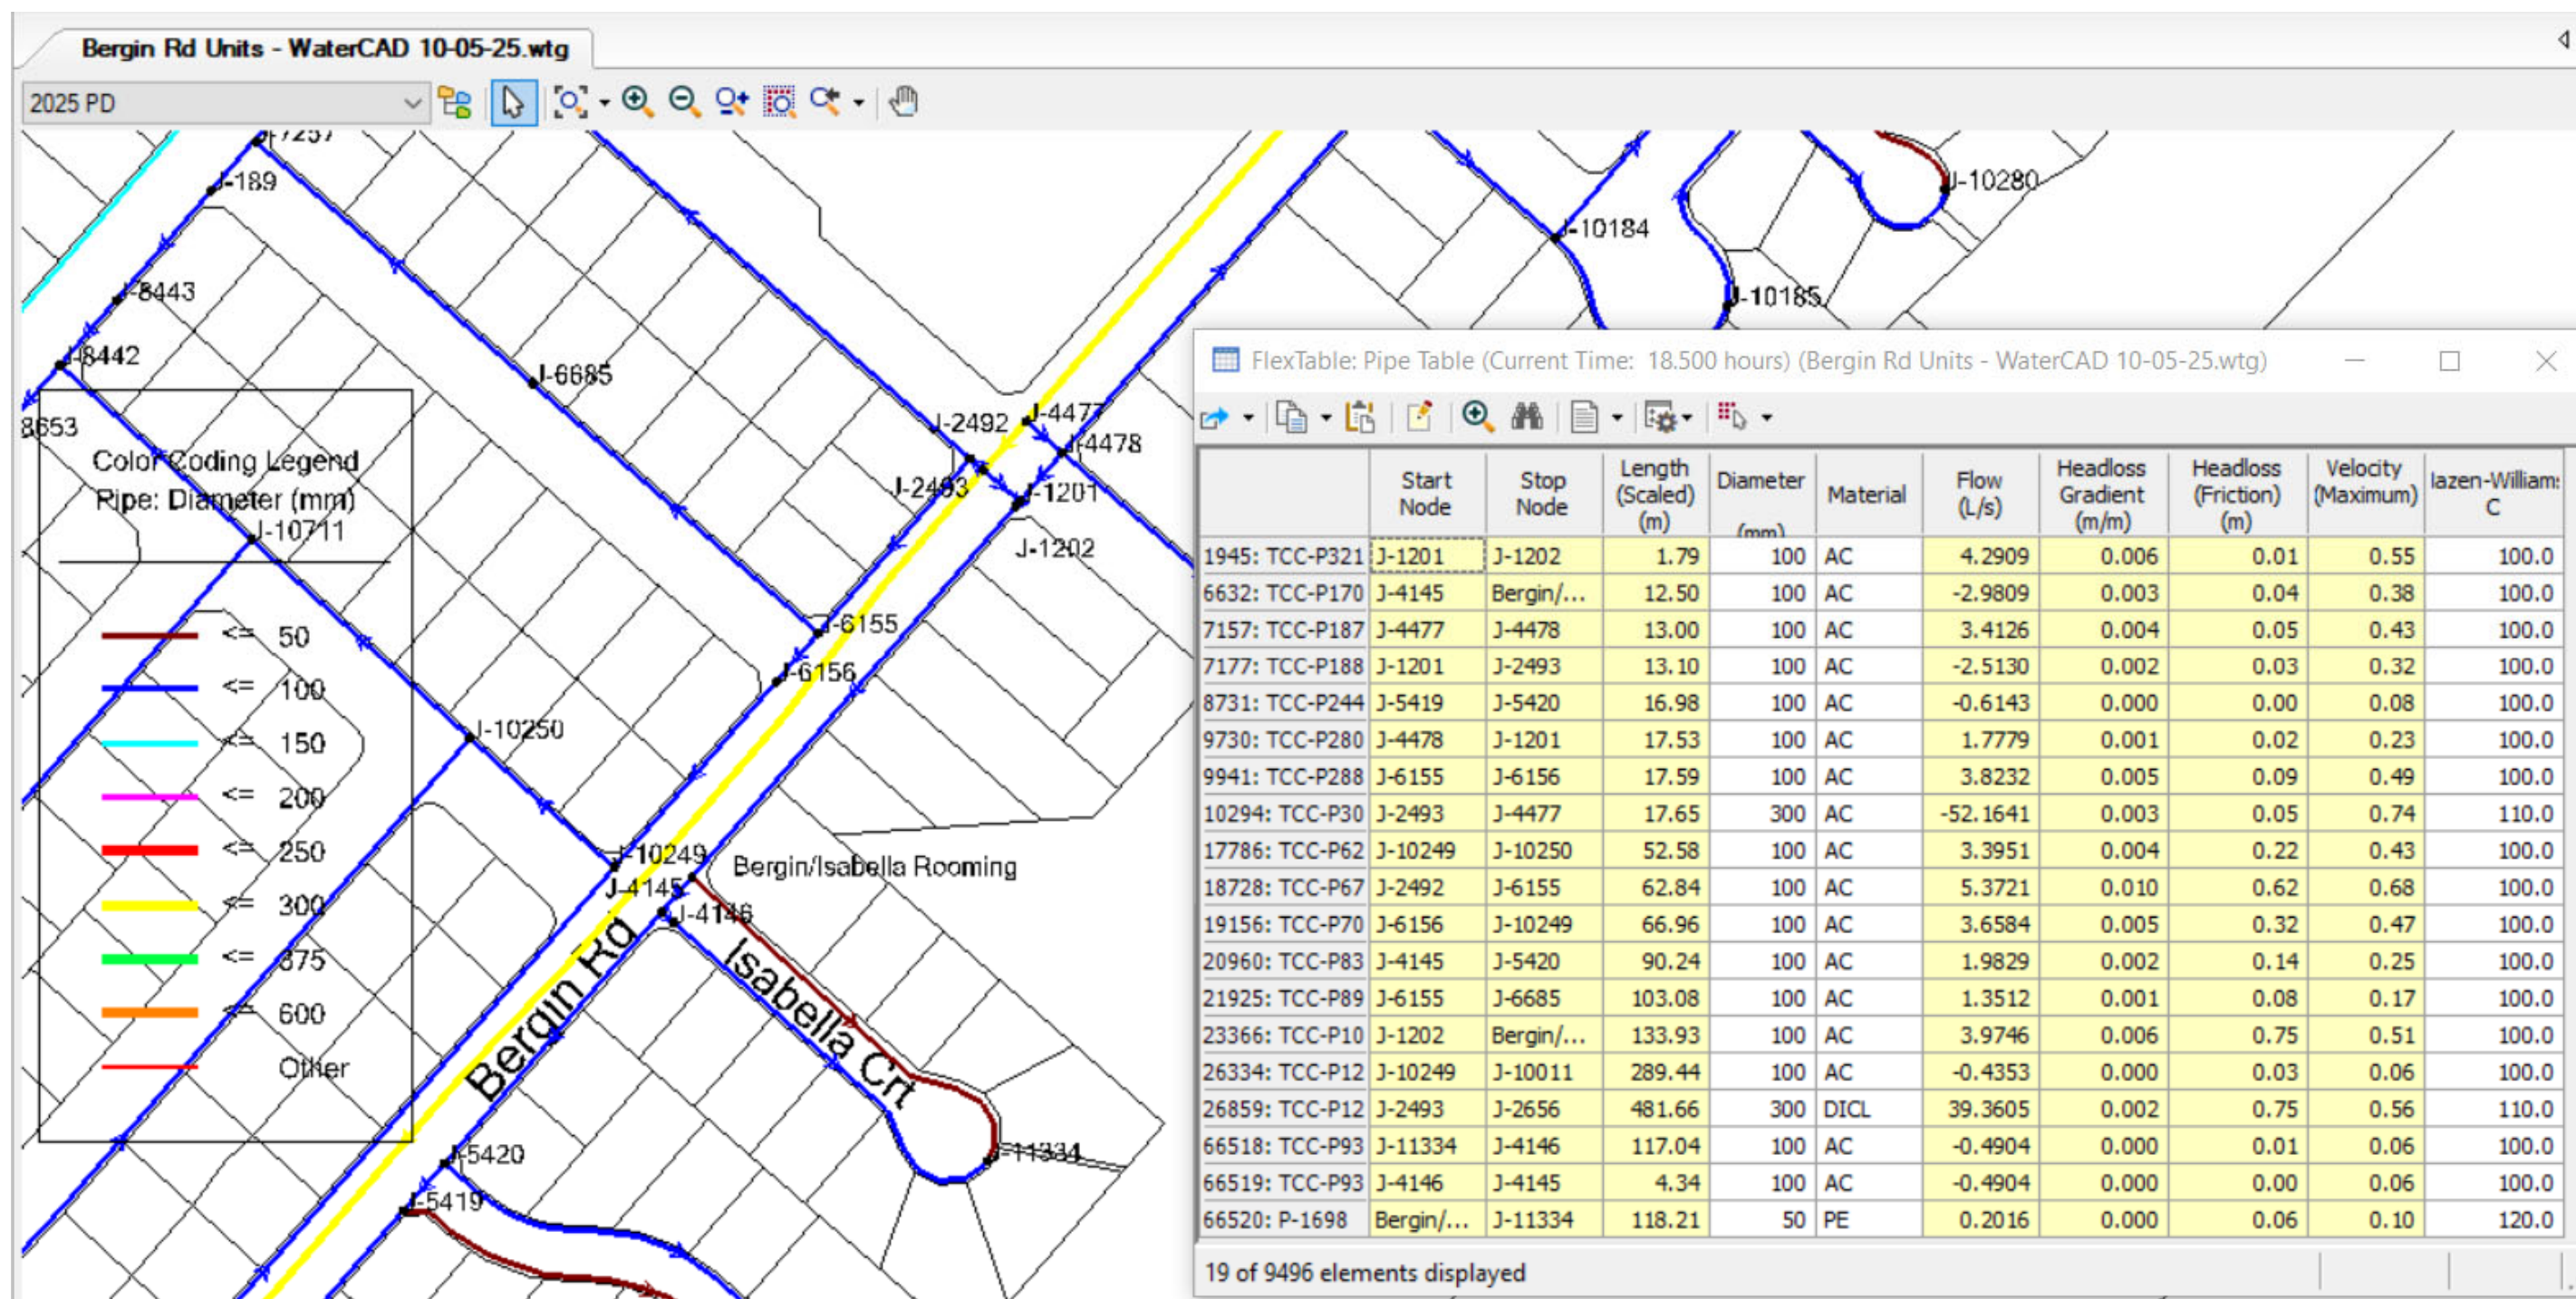

Peak Hour Pipes Modelling Results – 6:30 pm

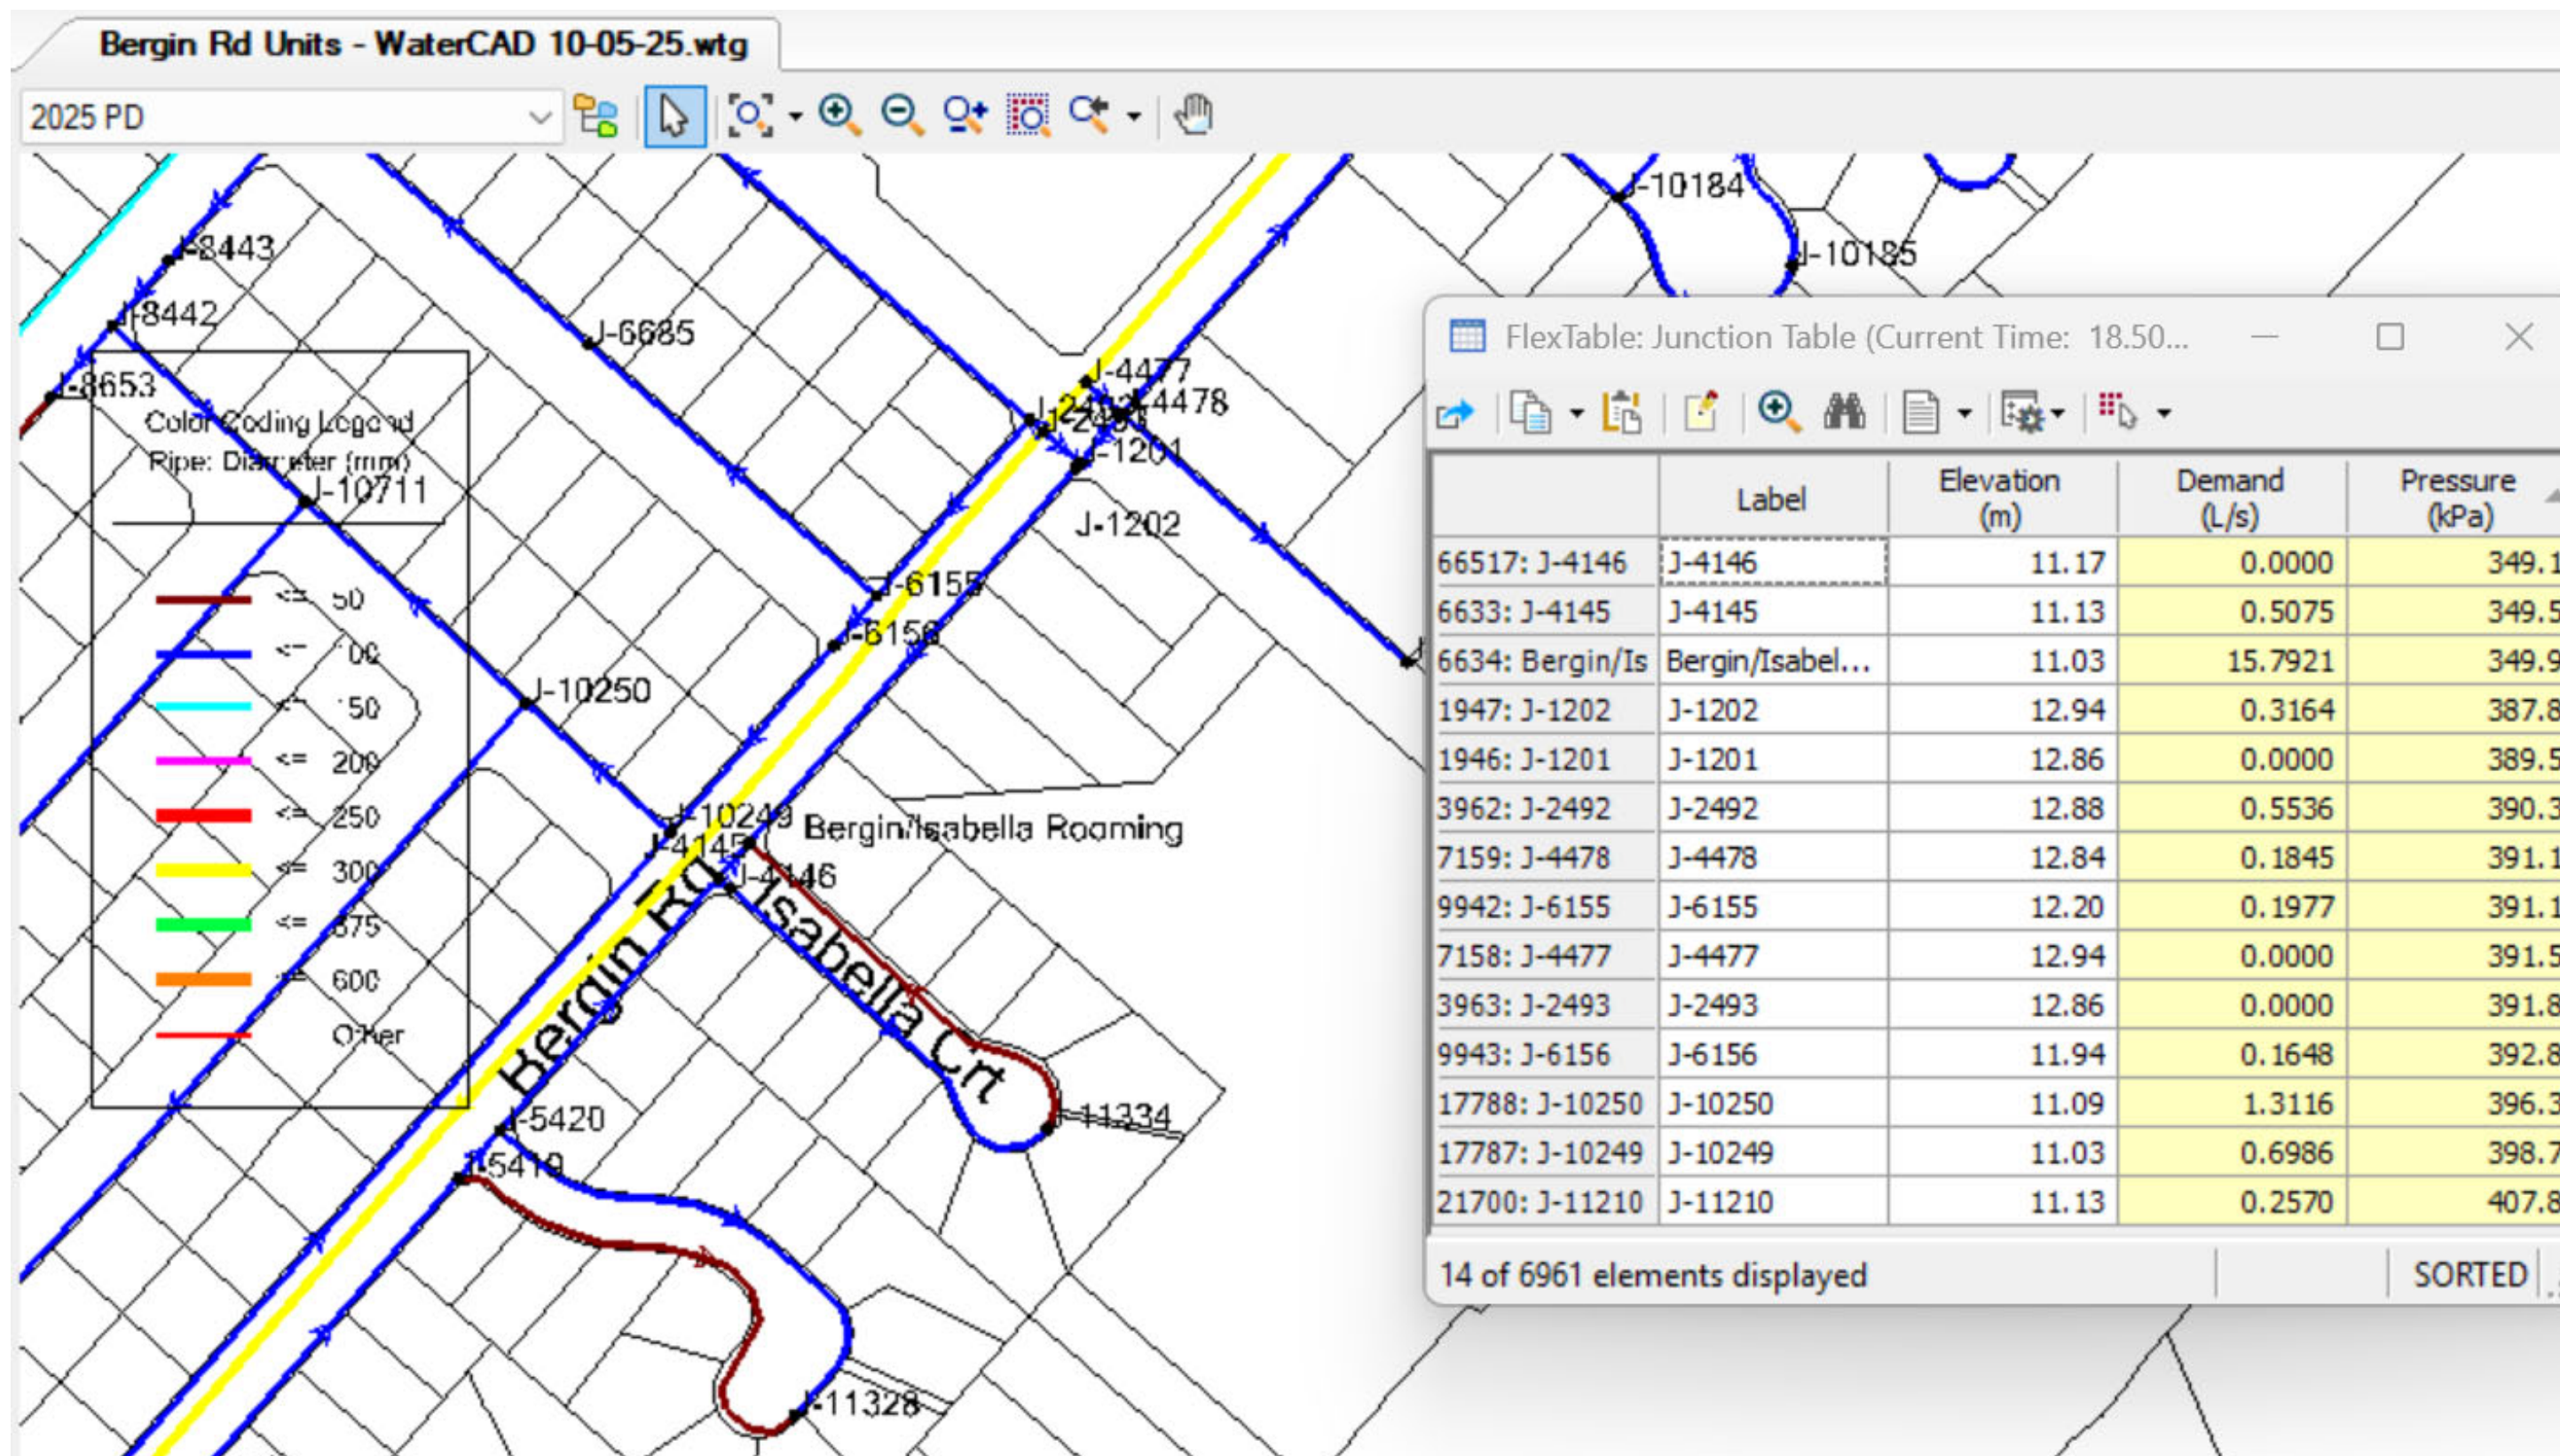


Peak Hour Node + 15 l/s Fire Flow Results – 6:30 pm

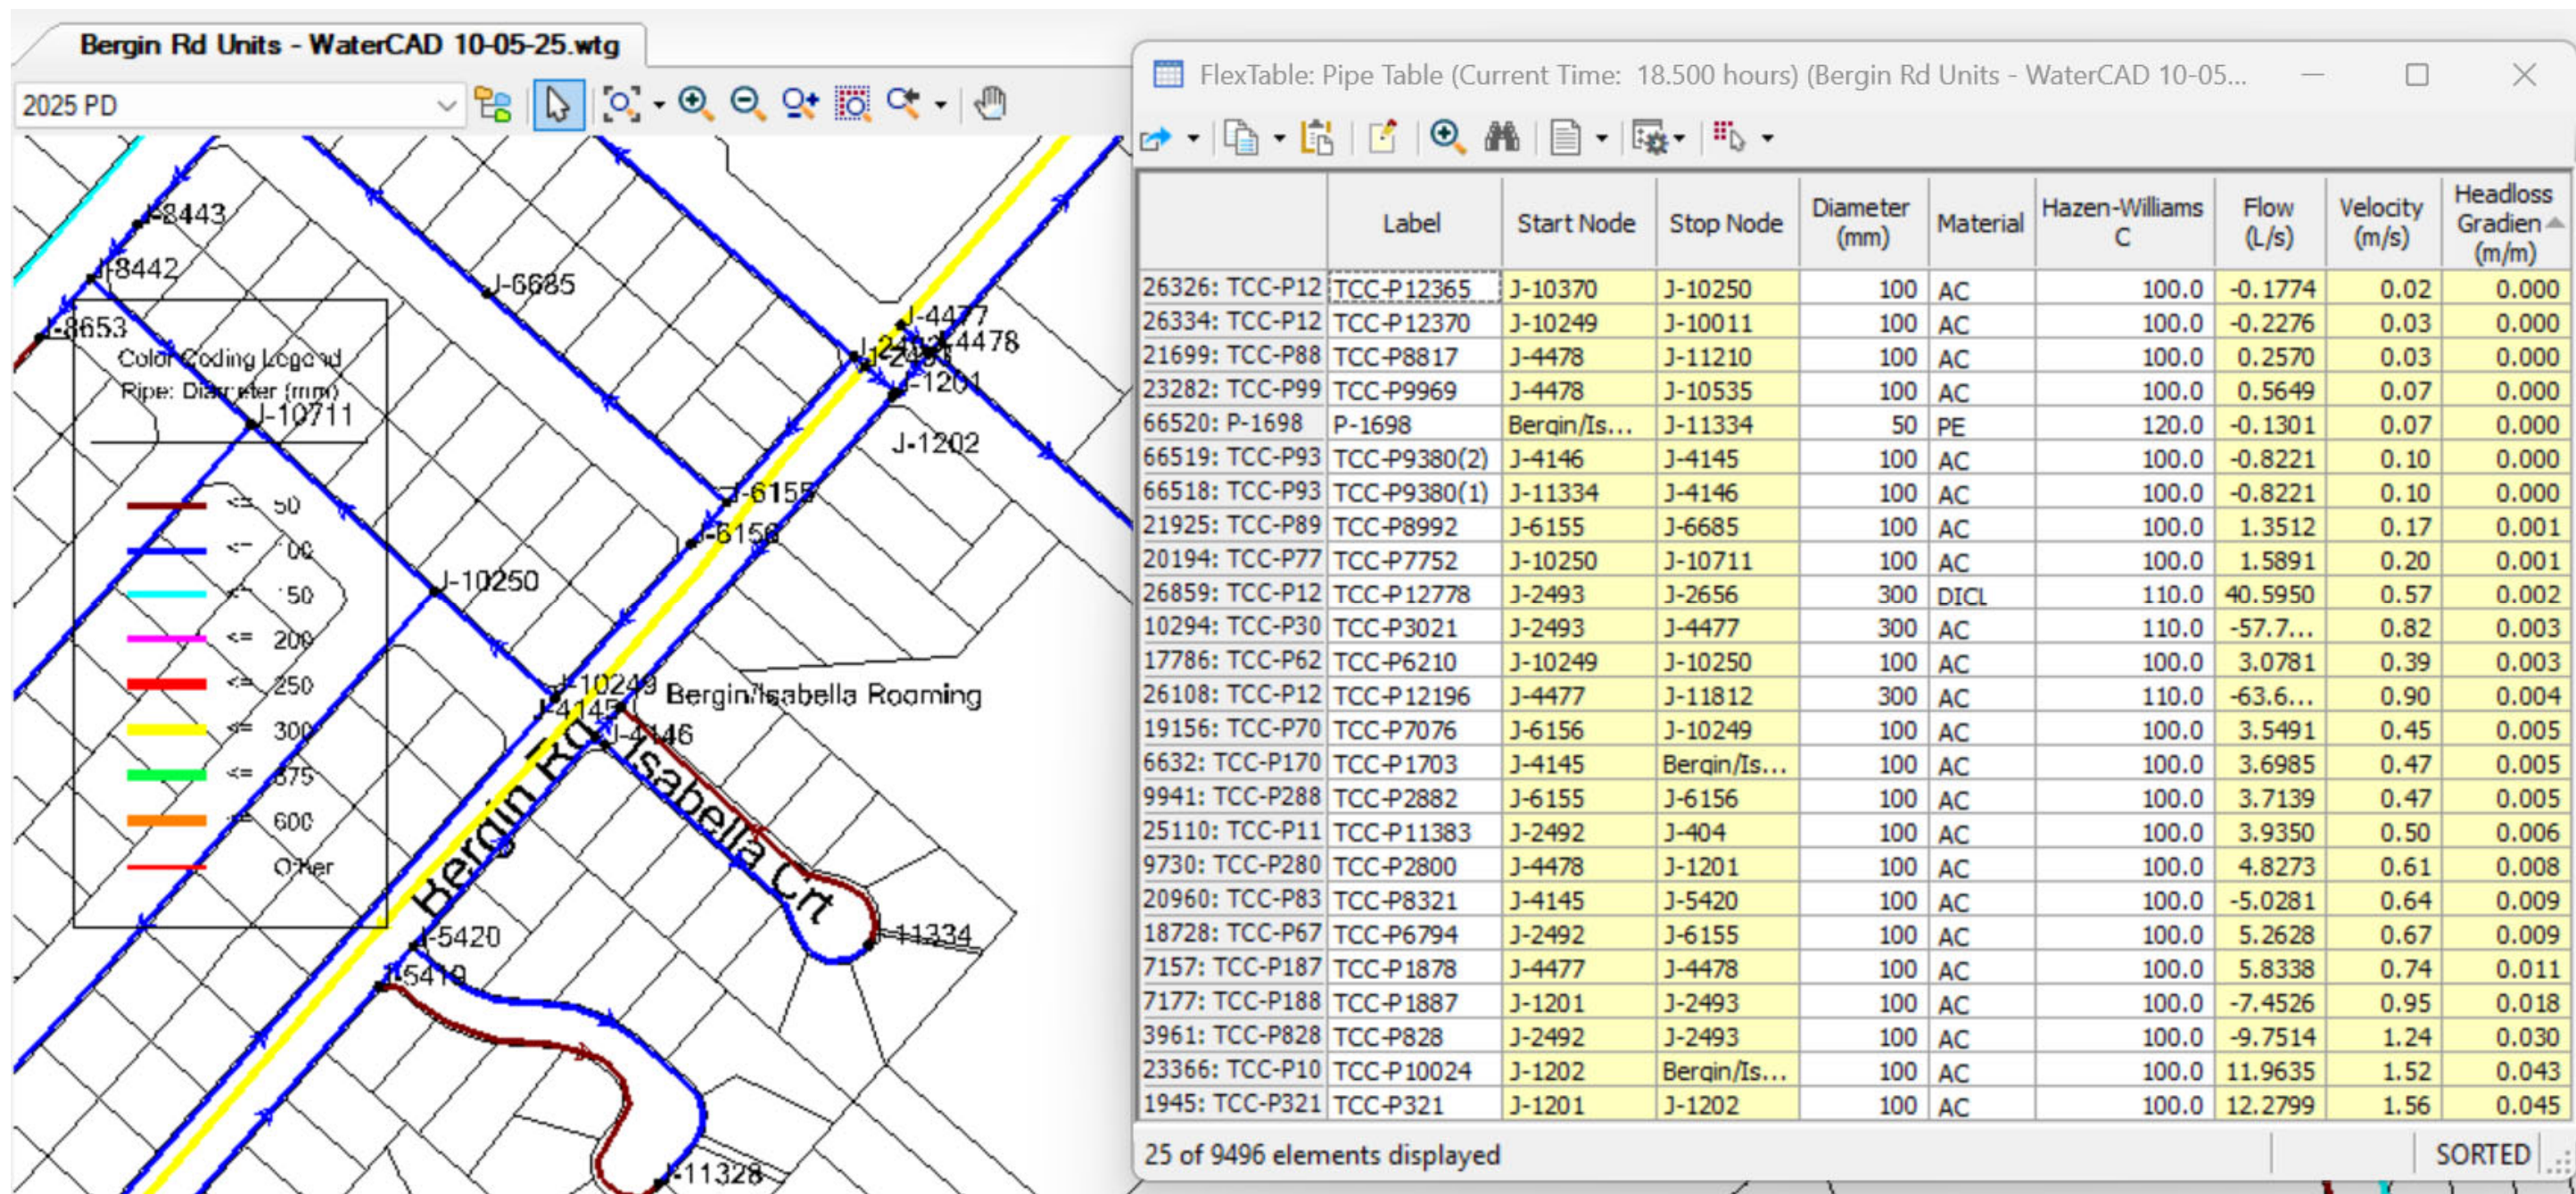

Peak Hour Pipes + 15 l/s Fire Flow Modelling Results – 6:30 pm

APPENDIX C

SEWERGEMS MODELLING RESULTS & FIGURES

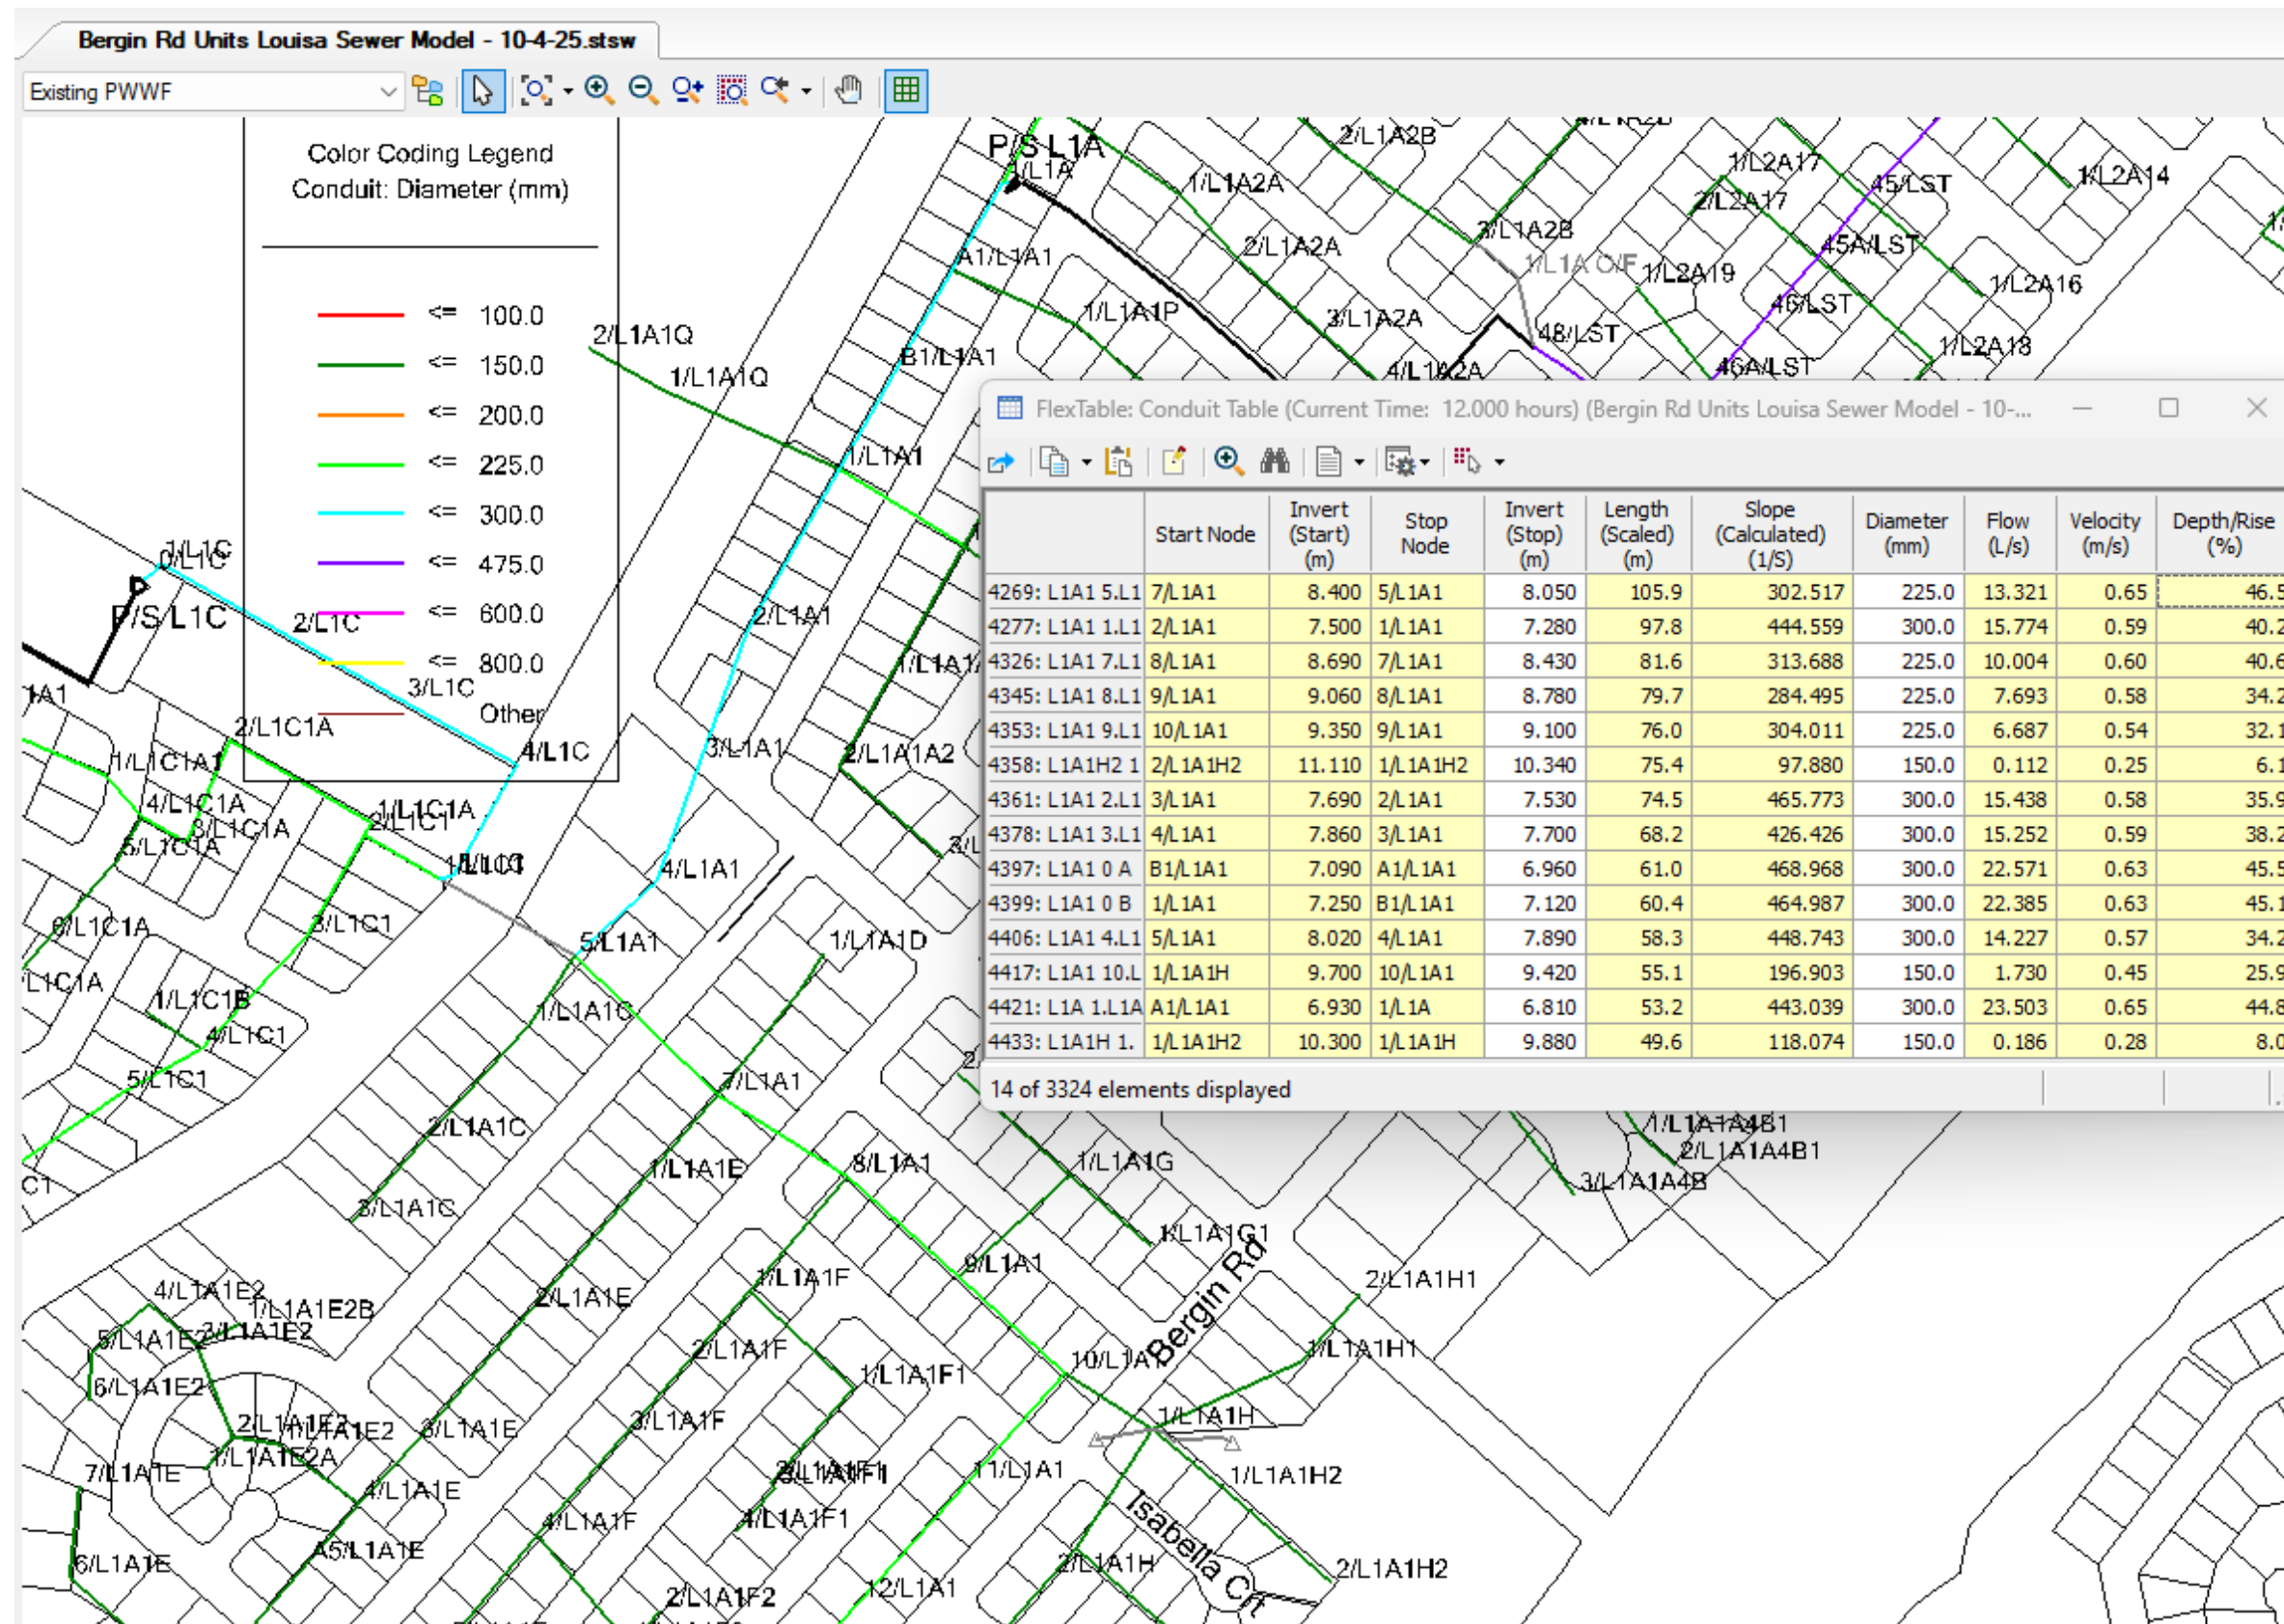

PWWF Sewer Capacity Assessment Results