

PROPOSED DEVELOPMENT HAVE YOUR SAY

MAJOR ELECTRICITY INFRASTRUCTURE (TRANSMISSION LINES) AND SUBSTATION

📍 128 Manton Quarry Road, Calcium Qld 4816

📍 Lot 19 SP321818, Lot 87 RP911426, Lot 30 SP321818, Lot 55 E124248, Lot 65 E124264, Lot 64 E124248, Lot 417 E12421

🔍 Approval sought: Development Permit for Material Change of Use


📄 Application reference: MCU26/0034

🏢 **Make a submission: 19 October to 10 November 2026**




Building height

- Substation: 20m
- Transmission tower: 52m

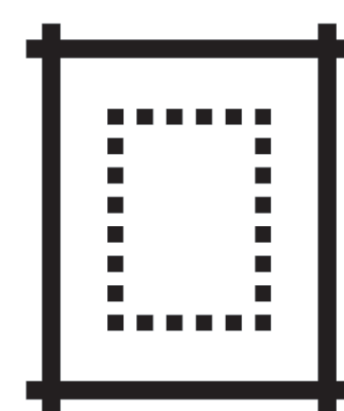

Setbacks (approximate)

- Bindal Drive: 60m
- Bidwilli Road to be closed

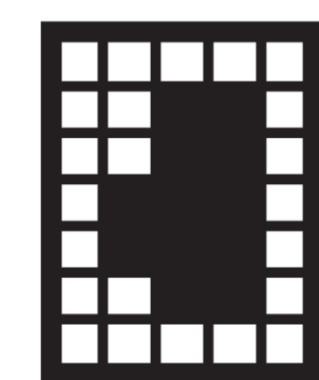

Site cover

- N/A

For further information and to view a copy of the application, contact:

- City of Townsville
- www.townsville.qld.gov.au
- 13 48 10


Submissions can be made to:

- City of Townsville
- PO Box 1268, Townsville Qld 4810
- developmentassessment@townsville.qld.gov.au


Written submissions may be made electronically; and electronic submissions are to be sent to developmentassessment@townsville.qld.gov.au and all submissions, including individual submitter's particulars, will be published on Council's website (eplanning.townsville.qld.gov.au) and therefore will be accessible to internet search engines.

To be eligible for appeal rights under the Planning Act 2016 submissions must be received within the period to make a submission stated above.

PROPOSED PROJECT LAYOUT AND GENERAL ARRANGEMENT

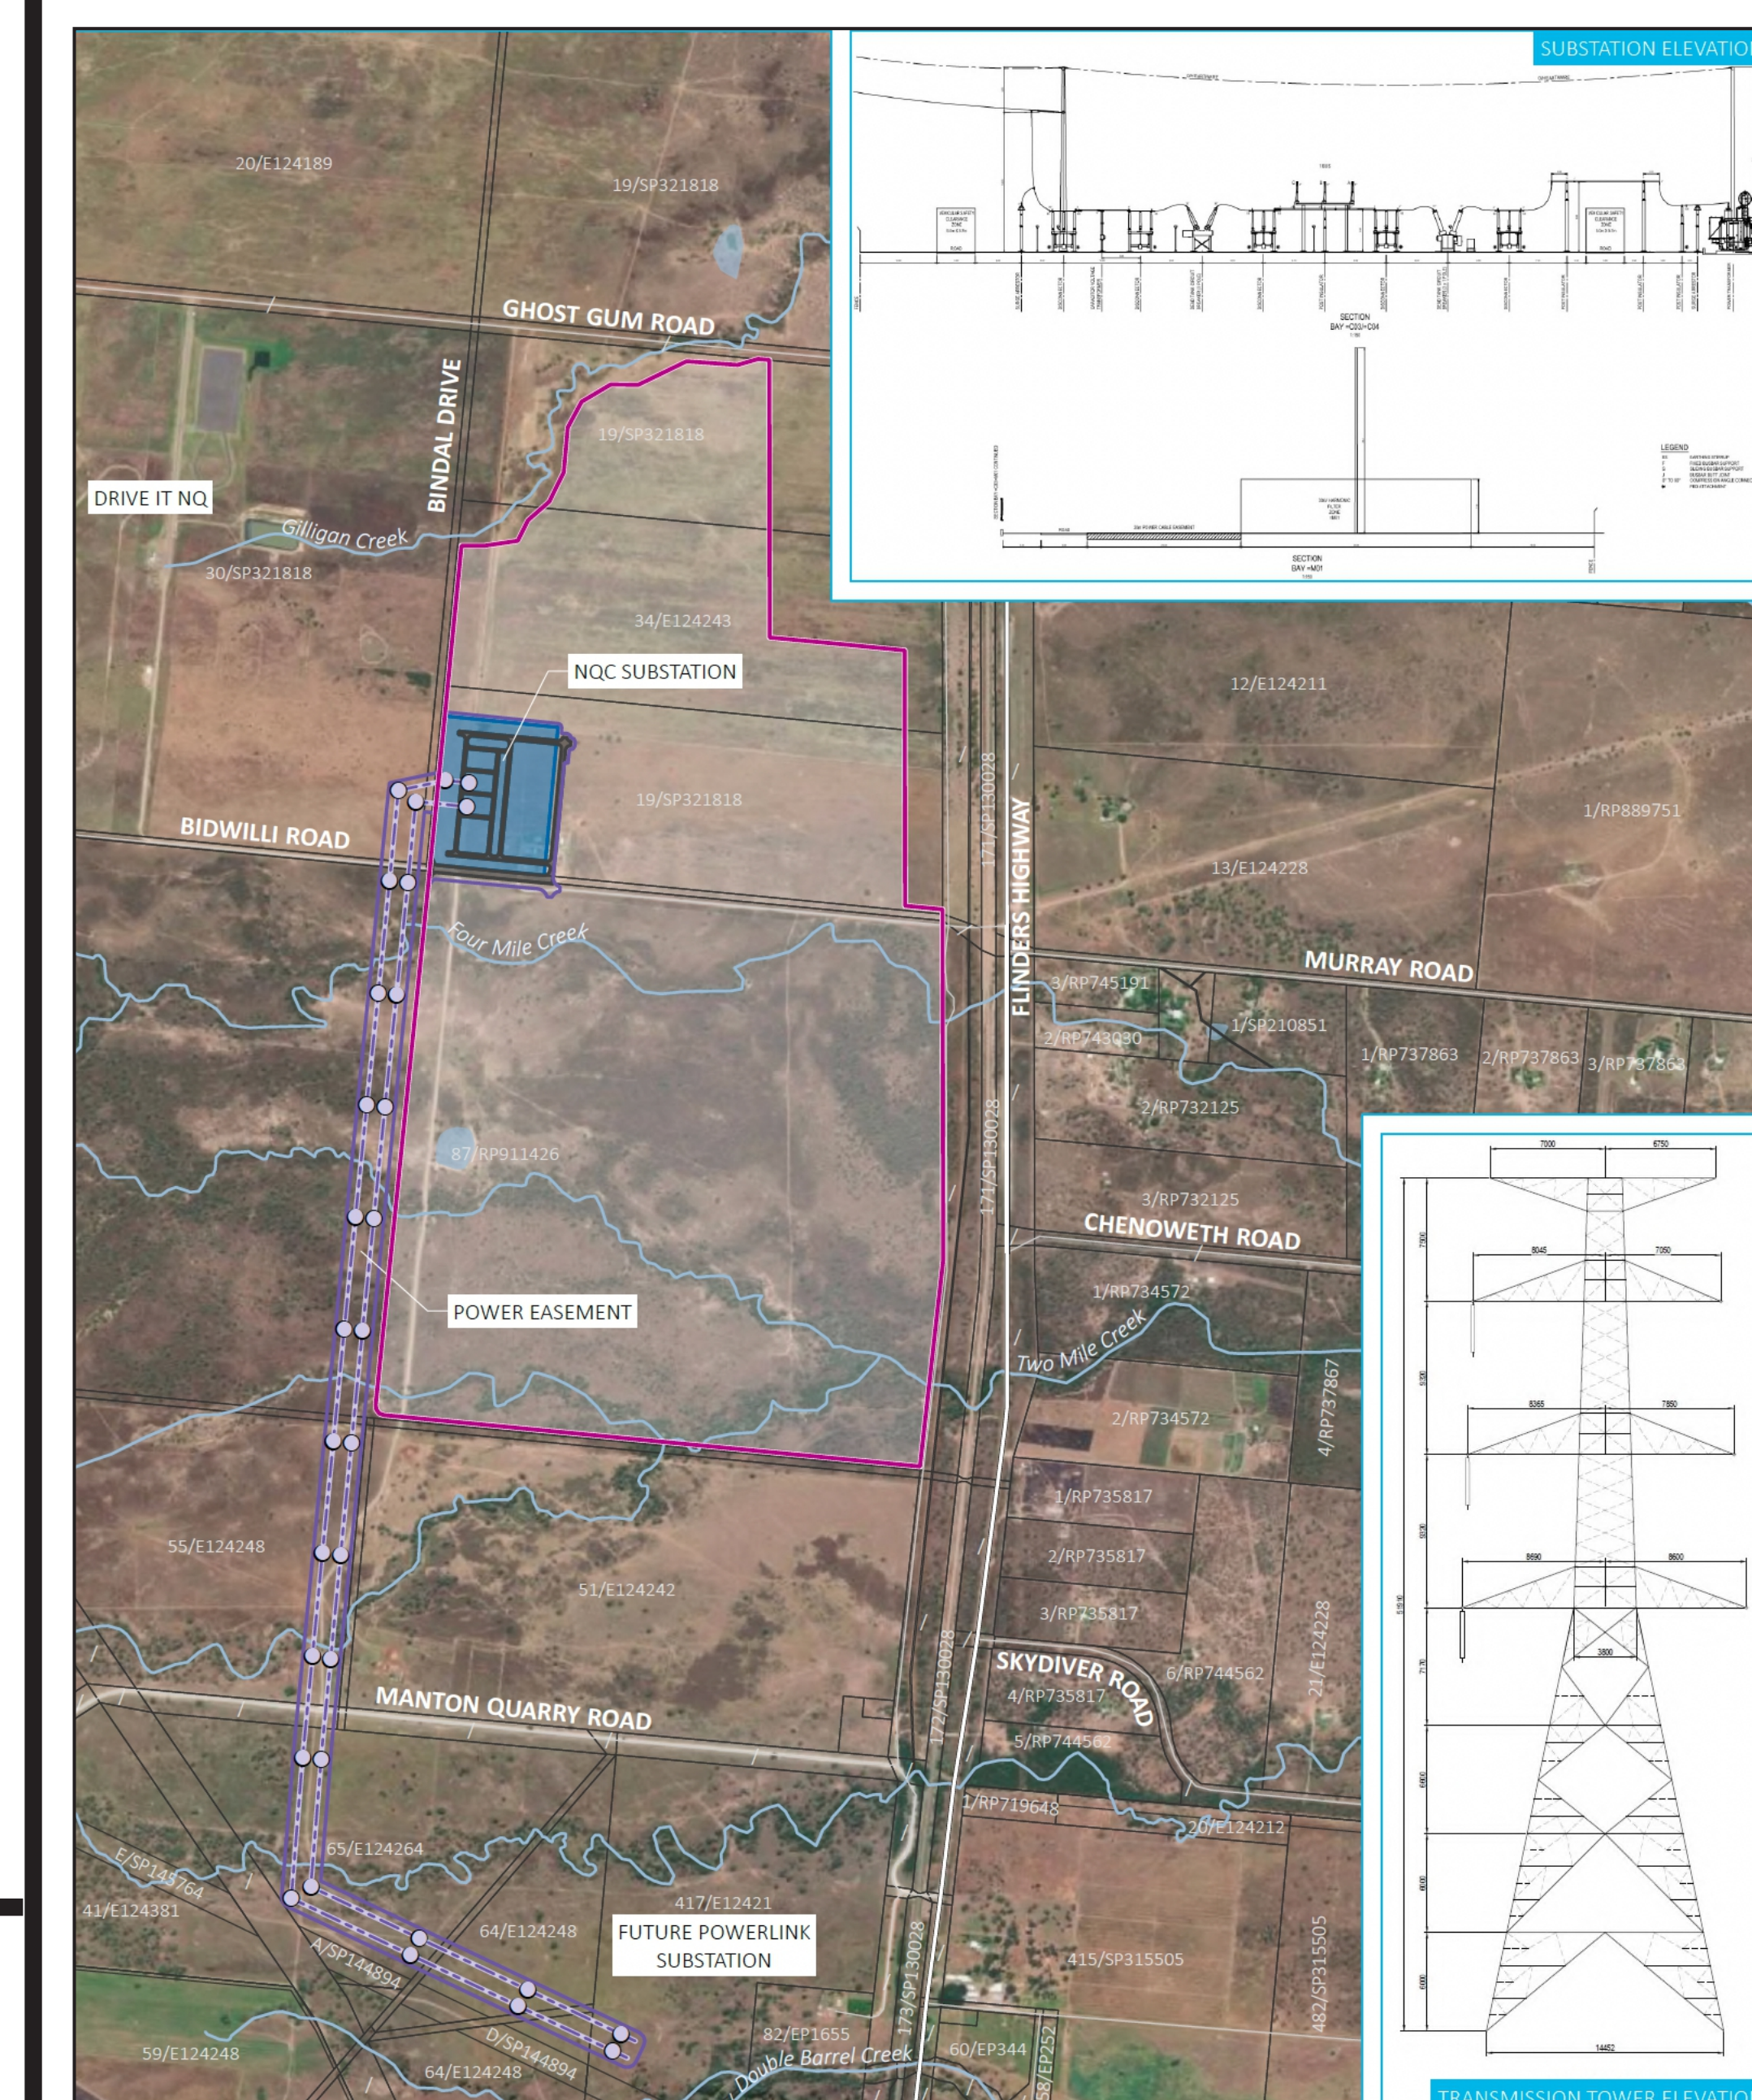

KEY	
Northern Quartz Campus	Proposed site layout
Premises	Substation
Existing environment	Internal road
Major road	Transmission line
Minor road	Transmission pole
Watercourse/drainage line	
Cadastral boundary	

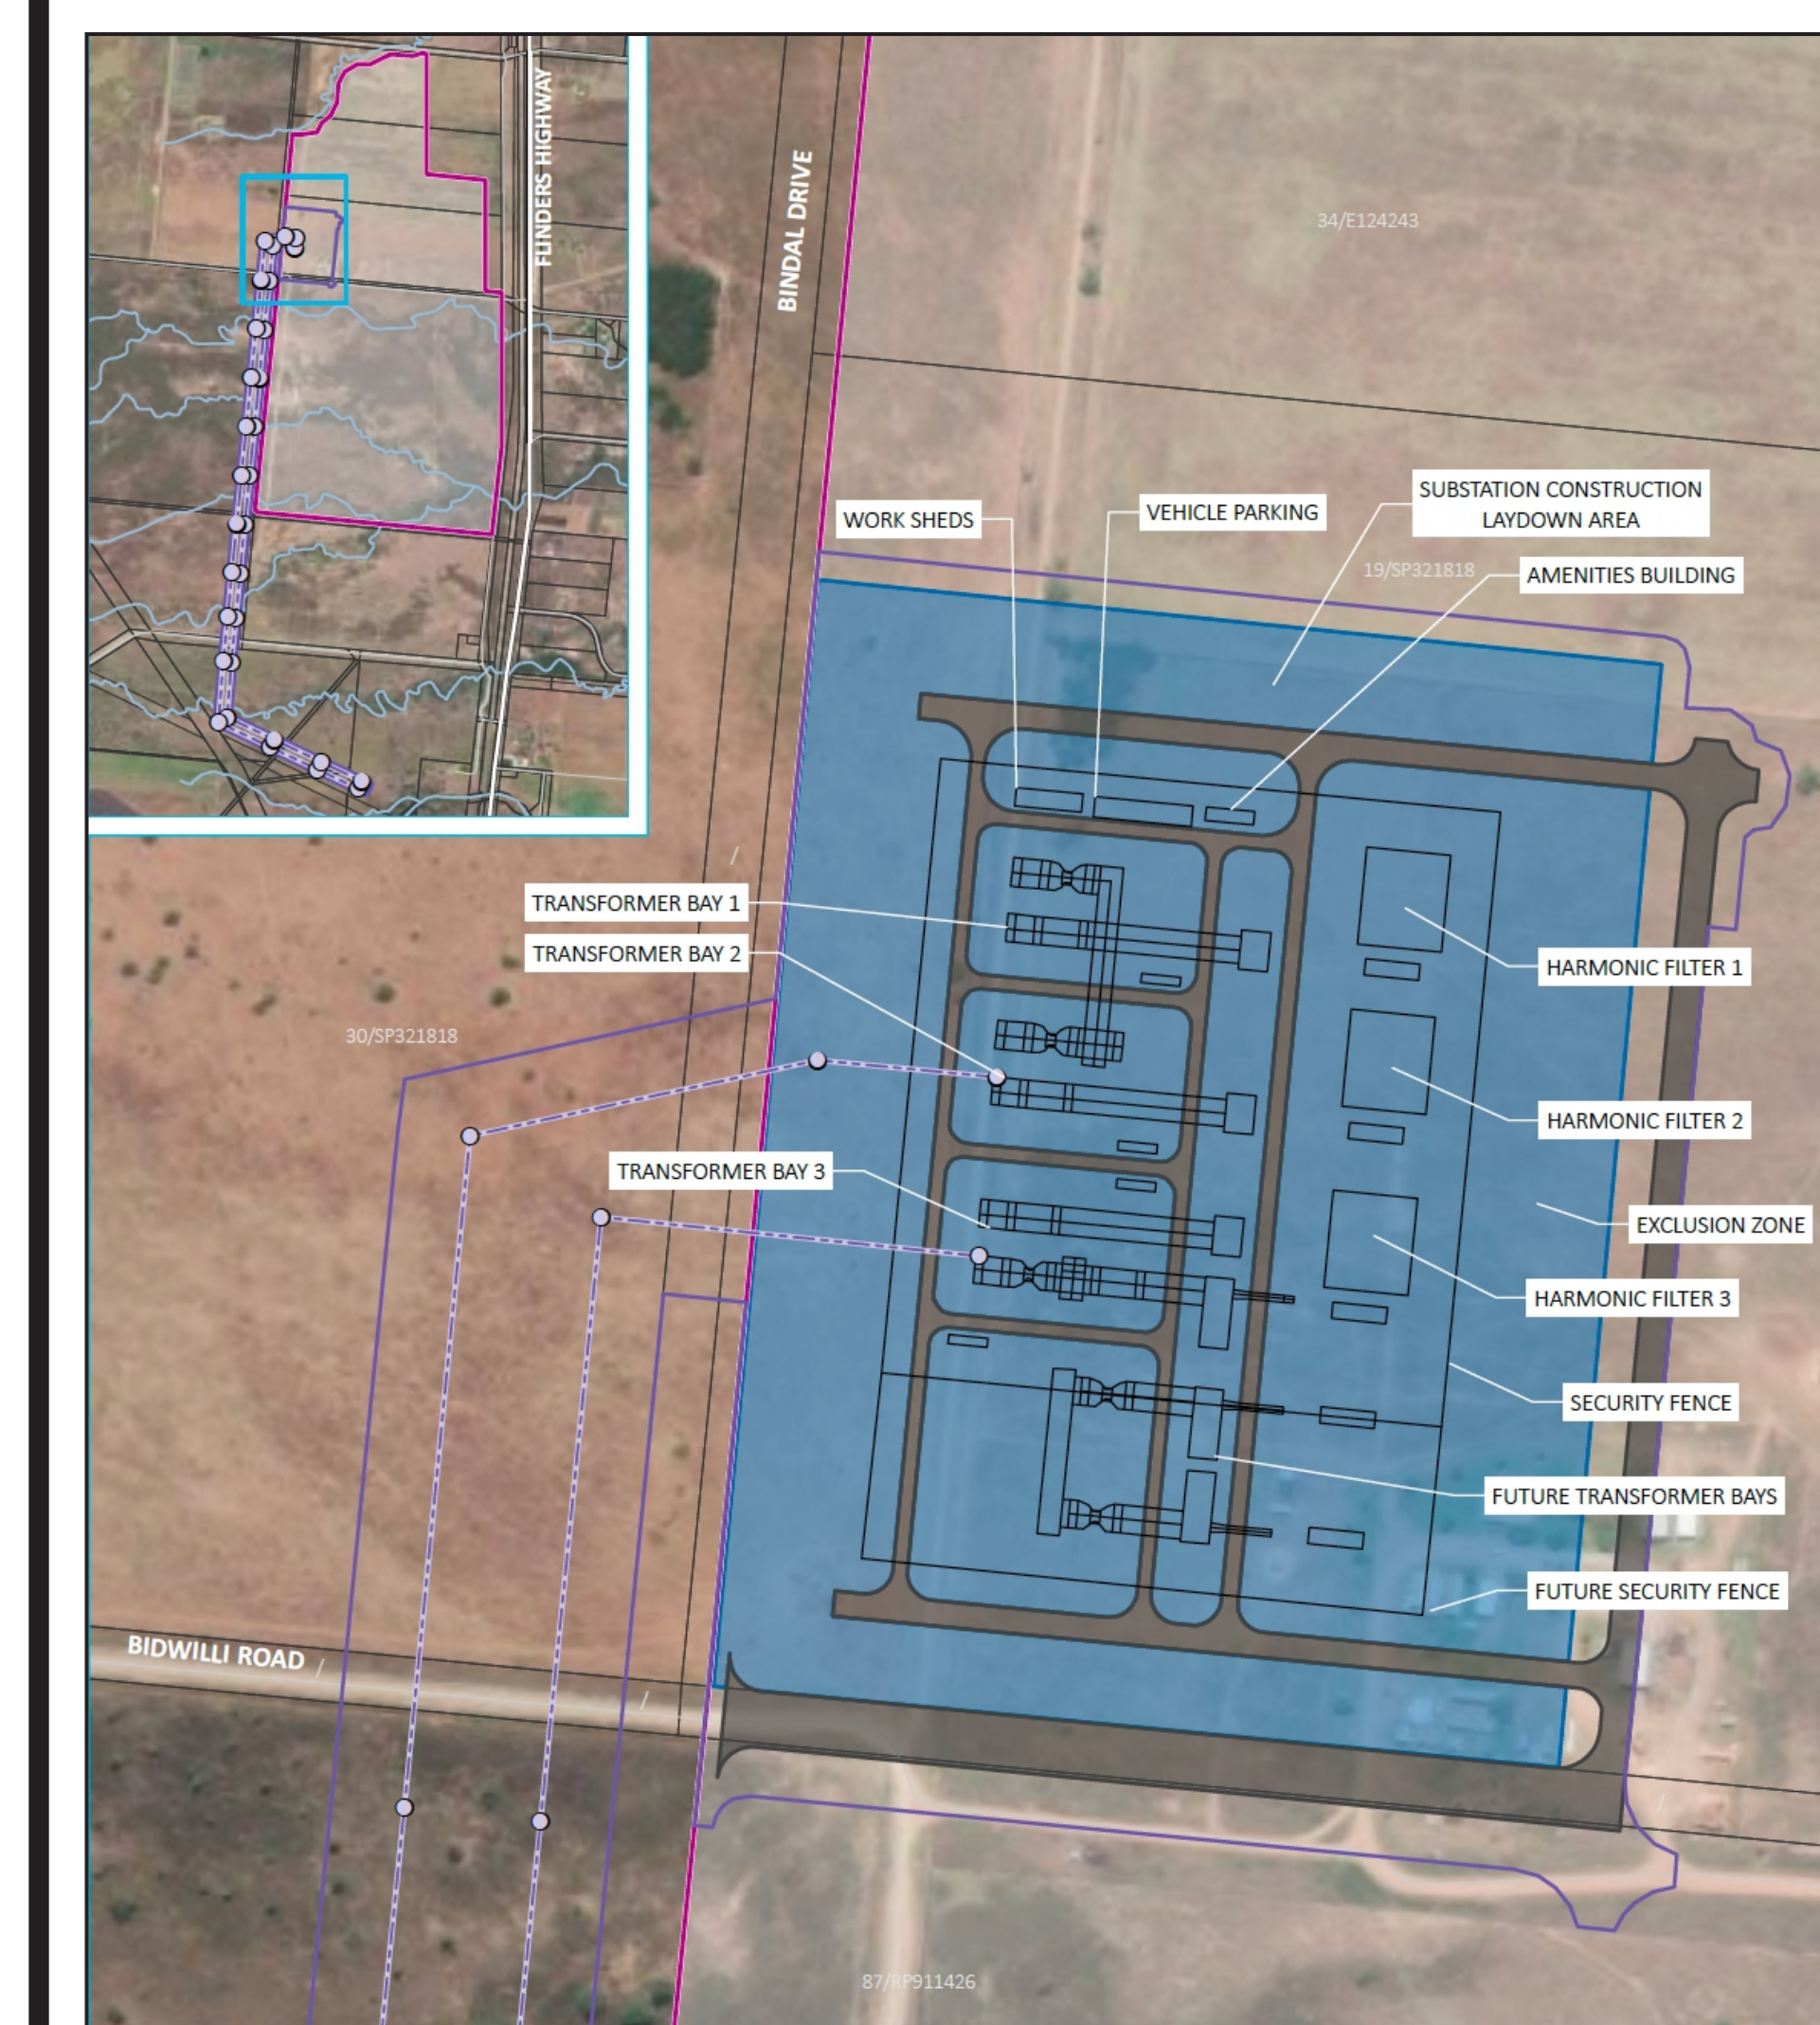

KEY	
Northern Quartz Campus	Existing environment
Premises	Minor road
Proposed site layout	Watercourse/drainage line
Substation	Waterbody
Internal road	Cadastral boundary
Substation infrastructure	
Transmission line	
Transmission pole	